

# Technical Information

## Proline Prowirl D 200

Vortex flowmeter



Cost-effective wafer design, available as compact or remote device version

### Application

- Preferred measuring principle for wet/saturated/ superheated steam, gases & liquids (also cryogenic)
- For all basic applications and for 1-to-1 replacement of orifice plates

### Device properties

- Installation length of 65 mm (2.56 in)
- No flanges
- Low weight
- Display module with data transfer function
- Robust two-chamber housing
- Plant safety: worldwide approvals (SIL, Haz. area)

### Your benefits

- Integrated temperature measurement for mass/energy flow of saturated steam
- Easy alignment of the sensor – included centering rings
- High availability – proven robustness, resistance to vibrations, temperature shocks & water hammer
- No maintenance – lifetime calibration
- Convenient device wiring – separate connection compartment
- Safe operation – no need to open the device due to display with touch control, background lighting
- Integrated verification – Heartbeat Technology™







## Table of contents

<b>Document information</b> . . . . .	<b>3</b>	Vibration resistance . . . . .	53
Symbols used . . . . .	3	Electromagnetic compatibility (EMC) . . . . .	53
<b>Function and system design</b> . . . . .	<b>4</b>	<b>Process</b> . . . . .	<b>53</b>
Measuring principle . . . . .	4	Medium temperature range . . . . .	53
Measuring system . . . . .	7	Pressure-temperature ratings . . . . .	53
<b>Input</b> . . . . .	<b>7</b>	Pressure loss . . . . .	54
Measured variable . . . . .	7	Thermal insulation . . . . .	54
Measuring range . . . . .	13	Vibrations . . . . .	55
Operable flow range . . . . .	13	<b>Mechanical construction</b> . . . . .	<b>55</b>
Input signal . . . . .	13	Design, dimensions . . . . .	55
<b>Output</b> . . . . .	<b>14</b>	Weight . . . . .	62
Output signal . . . . .	14	Materials . . . . .	65
Signal on alarm . . . . .	16	<b>Operability</b> . . . . .	<b>67</b>
Load . . . . .	17	Operating concept . . . . .	67
Ex connection data . . . . .	17	Local operation . . . . .	68
Low flow cut off . . . . .	21	Remote operation . . . . .	69
Galvanic isolation . . . . .	21	<b>Certificates and approvals</b> . . . . .	<b>71</b>
Protocol-specific data . . . . .	21	CE mark . . . . .	71
<b>Power supply</b> . . . . .	<b>24</b>	C-Tick symbol . . . . .	71
Terminal assignment . . . . .	24	Ex approval . . . . .	71
Pin assignment, device plug . . . . .	25	Functional safety . . . . .	73
Supply voltage . . . . .	25	Certification PROFIBUS . . . . .	73
Power consumption . . . . .	26	Pressure Equipment Directive . . . . .	73
Current consumption . . . . .	26	Other standards and guidelines . . . . .	73
Power supply failure . . . . .	26	<b>Ordering information</b> . . . . .	<b>74</b>
Electrical connection . . . . .	27	<b>Application packages</b> . . . . .	<b>74</b>
Potential equalization . . . . .	31	Diagnostics functions . . . . .	74
Terminals . . . . .	31	Heartbeat Technology . . . . .	75
Cable entries . . . . .	31	Air and industrial gases . . . . .	75
Cable specification . . . . .	31	Natural gas . . . . .	75
Overvoltage protection . . . . .	32	<b>Accessories</b> . . . . .	<b>75</b>
<b>Performance characteristics</b> . . . . .	<b>33</b>	Device-specific accessories . . . . .	76
Reference operating conditions . . . . .	33	Communication-specific accessories . . . . .	77
Maximum measured error . . . . .	33	Service-specific accessories . . . . .	78
Repeatability . . . . .	35	System components . . . . .	78
Response time . . . . .	35	<b>Documentation</b> . . . . .	<b>79</b>
Influence of ambient temperature . . . . .	35	Standard documentation . . . . .	79
<b>Installation</b> . . . . .	<b>35</b>	Supplementary device-dependent documentation . . . . .	79
Mounting location . . . . .	35	<b>Registered trademarks</b> . . . . .	<b>80</b>
Orientation . . . . .	36		
Inlet and outlet runs . . . . .	37		
Mounting kit . . . . .	38		
Length of connecting cable . . . . .	39		
Installing the wall-mount housing . . . . .	39		
Special mounting instructions . . . . .	41		
<b>Environment</b> . . . . .	<b>41</b>		
Ambient temperature range . . . . .	41		
Storage temperature . . . . .	52		
Climate class . . . . .	52		
Degree of protection . . . . .	53		









## Document information

### Symbols used

### Electrical symbols




Symbol	Meaning
 A0011197	<b>Direct current</b> A terminal to which DC voltage is applied or through which direct current flows.
 A0011198	<b>Alternating current</b> A terminal to which alternating voltage is applied or through which alternating current flows.
 A0017381	<b>Direct current and alternating current</b> <ul style="list-style-type: none"> <li>■ A terminal to which alternating voltage or DC voltage is applied.</li> <li>■ A terminal through which alternating current or direct current flows.</li> </ul>
 A0011200	<b>Ground connection</b> A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.
 A0011199	<b>Protective ground connection</b> A terminal which must be connected to ground prior to establishing any other connections.
 A0011201	<b>Equipotential connection</b> A connection that has to be connected to the plant grounding system: This may be a potential equalization line or a star grounding system depending on national or company codes of practice.

### Symbols for certain types of information

Symbol	Meaning
 A0011182	<b>Permitted</b> Indicates procedures, processes or actions that are permitted.
 A0011183	<b>Preferred</b> Indicates procedures, processes or actions that are preferred.
 A0011184	<b>Forbidden</b> Indicates procedures, processes or actions that are forbidden.
 A0011193	<b>Tip</b> Indicates additional information.
 A0011194	<b>Reference to documentation</b> Refers to the corresponding device documentation.
 A0011195	<b>Reference to page</b> Refers to the corresponding page number.
 A0011196	<b>Reference to graphic</b> Refers to the corresponding graphic number and page number.
 A0015502	<b>Visual inspection</b>

### Symbols in graphics


Symbol	Meaning
1, 2, 3, ...	Item numbers
1., 2., 3., ...	Series of steps
A, B, C, ...	Views
A-A, B-B, C-C, ...	Sections

Symbol	Meaning
 A0013441	Flow direction
 A0011187	<b>Hazardous area</b> Indicates a hazardous area.
 A0011188	<b>Safe area (non-hazardous area)</b> Indicates the non-hazardous area.

## Function and system design

### Measuring principle

Vortex meters work on the principle of the *Karman vortex street*. When fluid flows past a bluff body, vortices are alternately formed on both sides with opposite directions of rotation. These vortices each generate a local low pressure. The pressure fluctuations are recorded by the sensor and converted to electrical pulses. The vortices develop very regularly within the permitted application limits of the device. Therefore, the frequency of vortex shedding is proportional to the volume flow.

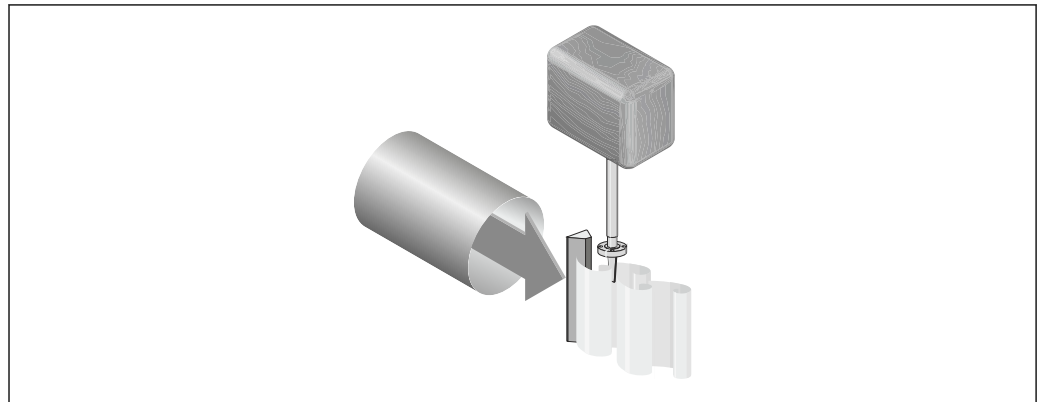

A0019373

The calibration factor (K-factor) is used as the proportional constant:

$$\text{K-Factor} = \frac{\text{Pulses}}{\text{Unit Volume [m}^3\text{]}}$$

A0009399-EN

Within the application limits of the device, the K-factor only depends on the geometry of the device. For  $Re > 20\,000$  it is:

- Independent of the flow velocity and the fluid properties viscosity and density
- Independent of the type of fluid under measurement: steam, gas or liquid

The primary measuring signal is linear to the flow. After production, the K-factor is determined in the factory by means of calibration. It is not subject to long-time drift or zero-point drift.

The device does not contain any moving parts and does not require any maintenance.

### The capacitance sensor

The sensor of a vortex flowmeter has a major influence on the performance, robustness and reliability of the entire measuring system.

The robust DSC sensor is:

- burst-tested
- tested against vibrations
- tested against thermal shock (thermal shocks of 150 K/s)

The Prowirl uses the tried-and-tested capacitance measuring technology of Endress+Hauser applied in over 300 000 measuring points worldwide.

The DSC (differential switched capacitance) sensor patented by Endress+Hauser has complete mechanical balancing. It only reacts to the measured variable (vortex) and does not react to vibrations. Even in the event of pipe vibrations, the smallest of flows can be reliably measured at low density thanks to the unimpaired sensitivity of the sensor. Thus, the wide turndown is also maintained even in the event of harsh operating conditions. Vibrations up to 1 g at least, at frequencies up to 500 Hz in every axis (X, Y, Z), do not affect the flow measurement. Thanks to its design, the capacitance sensor is also particularly mechanically resistant to temperature shocks and pressure shocks in steam pipelines.


#### Temperature measurement

Under the "Sensor version" order code the "Mass flow" option is available (→ 5). With this option the measuring device can also measure the temperature of the medium.

The temperature is measured via Pt 1000 temperature sensors. These sensors are located in the paddle of the DSC sensor and are therefore in the direct vicinity of the fluid.

Order code for "Sensor version":

- Option 1 "Volume flow, basis"
- Option 2 "Volume flow, high-temperature/low temperature"
- Option 3 "Mass flow (integrated temperature measurement)"

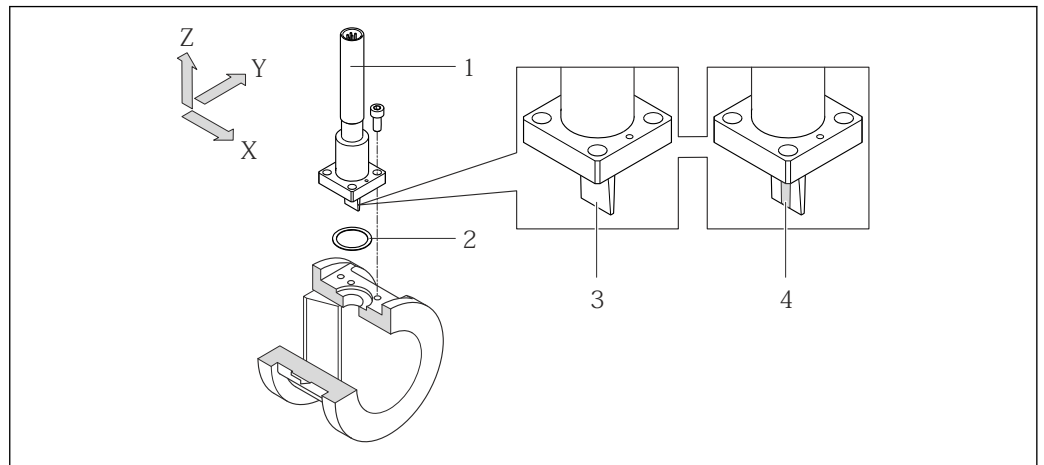

- 1 Sensor  
 2 Seal  
 3 Order code for "Sensor version", option 1 "Volume flow, basis" and option 2 "Volume flow, high-temperature/low-temperature"  
 4 Order code for "Sensor version", option 3 "Mass flow (integrated temperature measurement)"

#### Lifelong calibration

Experience has shown that recalibrated Prowirl devices demonstrate a very high degree of stability compared to their original calibration: The recalibration values were all within the original measuring accuracy specifications of the devices.

Various tests and simulation procedures carried out on devices by filing away the edges of Prowirl's bluff body found that there was no negative impact on the accuracy up to a rounding diameter of 1 mm (0.04 in).

If the meter's edges do not show rounding at the edges that exceeds 1 mm (0.04 in), the following general statements apply (for non-abrasive and non-corrosive media, such as in most water and steam applications):

- The measuring device does not display an offset in the calibration and the accuracy is still guaranteed.
- All the edges on the bluff body have a radius that is typically smaller in size. As the measuring devices are naturally also calibrated with these radii, the measuring device remains within the specified accuracy rating provided that the additional radius that is produced as a result of wear and tear does not exceed 1 mm (0.04 in).

Consequently it can be said that the Prowirl product line offers lifelong calibration if the measuring device is used in non-abrasive and non-corrosive media.

**Diagnostic functions**

In addition, the device offers extensive diagnostic options, such as tracing fluid and ambient temperatures, extreme flows etc.

Minimum and maximum values:

- Frequency
- Temperature
- Velocity
- Pressure


**Measuring system**

The device consists of a transmitter and a sensor.


Two device versions are available:

- Compact version - the transmitter and sensor form a mechanical unit.
- Remote version – the transmitter and sensor are mounted separately from one another.

**Transmitter**

<p><b>Prowirl 200</b></p>  <p style="text-align: right; font-size: small;">A0013471</p>	<p>Device versions and materials:</p> <ul style="list-style-type: none"> <li>■ Compact or remote version, aluminum coated: Coated aluminum AlSi10Mg</li> <li>■ Compact or remote version, stainless: For maximum corrosion resistance: stainless steel 1.4404 (316L)</li> </ul> <p>Configuration:</p> <ul style="list-style-type: none"> <li>■ Via four-line local display with key operation or via four-line, illuminated local display with touch control and guided menus ("Make-it-run" wizards) for applications</li> <li>■ Via operating tools (e.g. FieldCare)</li> </ul>
--	---

**Sensor**

<p><b>Prowirl D</b></p>  <p style="text-align: right; font-size: small;">A0009922</p>	<p>Disc (wafer version):</p> <ul style="list-style-type: none"> <li>■ Nominal diameter range: DN 15 to 150 (½ to 6")</li> <li>■ Materials: Measuring tubes: stainless steel, 1.4408 (CF3M)</li> </ul>
---	---

## Input

**Measured variable**

**Direct measured variables**

Order code for "Sensor version":

- Option 1 "Volume flow, basis" and
- Option 2 "Volume flow, high-temperature/low temperature":  
Volume flow

Order code for "Sensor version":

- Option 3 "Mass flow (integrated temperature measurement)":
  - Volume flow
  - Temperature

**Calculated measured variables**

Order code for "Sensor version":

- Option 1 "Volume flow, basis" and
- Option 2 "Volume flow, high-temperature/low temperature":
  - In the case of constant process conditions: Mass flow <sup>1)</sup> or Corrected volume flow
  - The totalized values for Volume flow, Mass flow <sup>1)</sup>, or Corrected volume flow

1) A fixed density must be entered for calculating the mass flow (Setup menu → Advanced setup submenu → External compensation submenu → Fixed density parameter).

Order code for "Sensor version":

Option 3 "Mass flow (integrated temperature measurement)":

- Mass flow
- Corrected volume flow
- Energy flow
- Heat flow difference
- Calculated saturated steam pressure



*Calculation of the measured variables*

The meter electronics system of the Prowirl 200 unit with the order code "Sensor version", option 3 "Mass flow (integrated temperature measurement)" has a flow computer. This computer can calculate the following secondary measured variables directly from the primary measured variables recorded using the pressure value (entered or external) and/or temperature value (measured or entered).

*Mass flow and corrected volume flow*

Medium	Fluid	Standards	Explanation
Steam <sup>1)</sup>	Superheated steam <sup>2)</sup>	IAPWS-IF97/ ASME	If the device features integrated temperature measurement and in the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA
	Saturated steam		Possible with integrated temperature measurement
	Wet steam <sup>3)</sup>		Steam with steam quality < 100 %
Gas	Single gas	NEL40	In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA
	Gas mixture	NEL40	
	Air	NEL40	
	Natural gas	ISO 12213-2	Contains AGA8-DC92 In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA
		AGA NX-19	In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA
		ISO 12213-3	Contains SGERG-88, AGA8 Gross Method 1 In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA
Other gases	Linear equation	Ideal gases In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	
Liquids	Water	IAPWS-IF97/ ASME	
	Liquefied gas	Tables	Propane and butane mixture
	Other liquid	Linear equation	Ideal liquids

- 1) The calculated values (mass flow, corrected volume flow) refer to the specific steam states for which the measuring device has been programmed (superheated steam, saturated steam or wet steam).
- 2) A warning is displayed if the steam state approaches the saturation line (2K; Diagnostic No. 871).
- 3) A warning is displayed if the steam quality drops below 80 % (Diagnostic No. 872).

*Mass flow calculation*

Volume flow × operating density

- Operating density for saturated steam, water and other liquids: depends on the temperature
- Operating density for superheated steam and all other gases: depends on the temperature and pressure

*Corrected volume flow calculation*

(Volume flow × operating density)/reference density

- Operating density for water and other liquids: depends on the temperature
- Operating density for all other gases: depends on the temperature and pressure

## Energy flow

Medium	Fluid	Standards	Explanation	Heat/energy option
Steam <sup>1)</sup>	Superheated steam <sup>2)</sup>	IAPWS-IF97/ASME	In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	Heat Gross calorific value <sup>3)</sup> in relation to mass Net calorific value <sup>4)</sup> in relation to mass Gross calorific value <sup>3)</sup> in relation to corrected volume Net calorific value <sup>4)</sup> in relation to corrected volume
	Saturated steam			
	Wet steam <sup>5)</sup>			
Gas	Single gas	ISO 6976	Contains GPA 2172 In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	
	Gas mixture	ISO 6976	Contains GPA 2172 In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	
	Air	NEL40	In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	
	Natural gas	ISO 6976	Contains GPA 2172 In the event of constant pressure, or if the pressure is read in via the current input/HART/PROFIBUS PA	
AGA 5				
Liquids	Water	IAPWS-IF97/ASME		
	Liquefied gas	ISO 6976	Contains GPA 2172	
	Other liquid	Linear equation		

- 1) The calculated values (mass flow, corrected volume flow) refer to the specific steam states for which the measuring device has been programmed (superheated steam, saturated steam or wet steam).
- 2) A warning is displayed if the steam state approaches the saturation line (2K; Diagnostic No. 871).
- 3) Gross calorific value: combustion energy + condensation energy of the flue gas (gross calorific value > net calorific value)
- 4) Net calorific value: only combustion energy
- 5) A warning is displayed if the steam quality drops below 80 % (Diagnostic No. 872).

## Mass flow and energy flow calculation

**NOTICE**

**The process pressure (p) in the process pipe is required to calculate the process variables and the limit values of the measuring range.**

- ▶ In the case of the HART device, the process pressure can be read in from an external transmitter (e.g. Cerabar-M) via the 4 to 20mA current input or via HART or entered as a fixed value in the **External compensation** submenu.
- ▶ In the case of the PROFIBUS PA device, the process pressure can be transmitted from the Profibus master to the measuring device via the AO Block or entered as a fixed value in the **External compensation** submenu.

The calculation is performed based on the following factors:

- Assuming superheated steam conditions the measuring device calculates until the saturation point is reached. At 2 K above saturation, warning 871 "Approaching saturation line" is triggered. The warning can be redefined as an alarm or can also be disabled .
- If the temperature continues to drop, assuming saturated steam conditions the measuring device continues measuring up to a temperature of 0 °C (+32 °F). If pressure is the preferred measured variable, the **Saturated steam** option must be selected in the **Select steam type** parameter and the **Pressure** option must be selected in the **Saturated steam calculation mode** parameter (**Expert** menu → **Sensor** submenu → **Measurement mode** submenu → **Saturated steam calculation mode** parameter).



Detailed information on external compensation is provided in the Operating Instructions for the device

#### Calculated value

The unit calculates the mass flow, heat flow, energy flow, density and specific enthalpy from the measured volume flow and the measured temperature and/or the pressure based on international standard IAPWS-IF97 (ASME steam data).

Formulae for calculation:

- Mass flow:  $m = q \cdot \rho (T, p)$
- Heat quantity:  $E = q \cdot \rho (T, p) \cdot h_D (T, p)$

$m$  = Mass flow

$E$  = Heat quantity

$q$  = Volume flow (measured)

$h_D$  = Specific enthalpy

$T$  = Operating temperature (measured)

$p$  = Process pressure

$\rho$  = Density <sup>2)</sup>

#### Pre-programmed gases

The following gases are pre-programmed in the flow computer:

Hydrogen <sup>1)</sup>	Helium 4	Neon	Argon
Krypton	Xenon	Nitrogen	Oxygen
Chlorine	Ammonia	Carbon monoxide <sup>1)</sup>	Carbon dioxide
Sulfur dioxide	Hydrogen sulfide <sup>1)</sup>	Hydrogen chloride	Methane <sup>1)</sup>
Ethane <sup>1)</sup>	Propane <sup>1)</sup>	Butane <sup>1)</sup>	Ethylene (ethene) <sup>1)</sup>
Vinyl chloride	Mixtures of up to 8 components of these gases <sup>1)</sup>		

- 1) The energy flow is calculated as per ISO 6976 (contains GPA 2172) or AGA5 - in relation to the net calorific value or gross calorific value .

#### Energy flow calculation

Volume flow × operating density × specific enthalpy

- Operating density for saturated steam and water: depends on the temperature
- Operating density for superheated steam, natural gas ISO 6976 (contains GPA 2172), natural gas AGA5: depends on the temperature and pressure

#### Heat flow difference

- Between saturated steam upstream from a heat exchanger and condensate downstream from the heat exchanger (second temperature read in via current input/HART/PROFIBUS PA) in accordance with IAPWS-IF97/ASME (→ 41).
- Between warm water and cold water (second temperature read in via current input/HART/PROFIBUS PA) in accordance with IAPWS-IF97/ASME.

2) From steam data as per IAPWS-IF97 (ASME), for the measured temperature and the specified pressure

*Vapor pressure and steam temperature*

The measuring device can perform the following in saturated steam measurements between the feed line and return line of any heating liquid (second temperature read in via current input/HART/PROFIBUS PA and Cp value entered):

- Calculate the saturation pressure of the steam from the measured temperature and output the value in accordance with IAPWS-IF97/ASME.
- Calculate the saturation temperature of the steam from the specified pressure and output the value in accordance with IAPWS-IF97/ASME.

*Saturated steam alarm*

In applications involving the measurement of superheated steam, the measuring device can trigger a saturated steam alarm when the value approaches the saturation curve.

*Total mass flow and condensate mass flow*

- Using the steam quality entered, the measuring device can calculate the total mass flow and output it in the form of the proportion of gas and liquid.
- Using the steam quality entered, the measuring device can calculate the condensate mass flow and output it in the form of the proportion of liquid.

**Measuring range**

The measuring range depends on the fluid and nominal diameter.

**Lower range value**

Depends on the density and the Reynolds number ( $Re_{min} = 5\,000$ ,  $Re_{linear} = 20\,000$ ). The Reynolds number is dimensionless and indicates the ratio of the inertia force of a fluid to its viscous force. It is used to characterize the flow. The Reynolds number is calculated as follows:

$$Re = \frac{4 \cdot Q \text{ [m}^3\text{/s]} \cdot \rho \text{ [kg/m}^3\text{]}}{\pi \cdot di \text{ [m]} \cdot \mu \text{ [Pa}\cdot\text{s]}} \qquad Re = \frac{4 \cdot Q \text{ [ft}^3\text{/s]} \cdot \rho \text{ [lb/ft}^3\text{]}}{\pi \cdot di \text{ [ft]} \cdot \mu \text{ [0.001 cP]}}$$

A0003794

$Re =$  Reynolds number;  $Q =$  flow;  $di =$  internal diameter;  $\mu =$  dynamic viscosity,  $\rho =$  density

$$\begin{aligned} \text{DN 15...150} &\rightarrow v_{min.} = \frac{6}{\sqrt{\rho \text{ [kg/m}^3\text{]}}} \text{ [m/s]} \\ \text{DN } \frac{1}{2}\text{...6"} &\rightarrow v_{min.} = \frac{4.92}{\sqrt{\rho \text{ [lb/ft}^3\text{]}}} \text{ [ft/s]} \end{aligned}$$

A0020557

**Upper range value**

**Liquids:**



The upper range value must be calculated as follows:

$v_{max} = 9 \text{ m/s (30 ft/s)}$  and  $v_{max} = 350/\sqrt{\rho} \text{ m/s (130/\sqrt{\rho} ft/s)}$

► Use the lower value.

*Gas/steam:*

Nominal diameter	$v_{max}$
Standard device: DN 15 (½")	46 m/s (151 ft/s) and $350/\sqrt{\rho} \text{ m/s (130/\sqrt{\rho} ft/s)}$ (Use the lower value.)
Standard device: DN 25 (1"), DN 40 (1½")	75 m/s (246 ft/s) and $350/\sqrt{\rho} \text{ m/s (130/\sqrt{\rho} ft/s)}$ (Use the lower value.)
Standard device: DN 50 to 150 (2 to 8")	120 m/s (394 ft/s) and $350/\sqrt{\rho} \text{ m/s (130/\sqrt{\rho} ft/s)}$ (Use the lower value.) Calibrated range: up to 75 m/s (246 ft/s)

 For information about the Applicator (→  78)

**Operable flow range**




Up to 45: 1 (ratio between lower and upper range value)

**Input signal**

**External measured values**

To increase the accuracy of certain measured variables or to calculate the corrected volume flow, the automation system can continuously write different measured values to the measuring device:

- Operating pressure to increase accuracy (Endress+Hauser recommends the use of a pressure measuring device for absolute pressure, e.g. Cerabar M or Cerabar S)
- Medium temperature to increase accuracy (e.g. iTEMP)
- Reference density for calculating the corrected volume flow

-  ■ Various pressure transmitters can be ordered from Endress+Hauser: see "Accessories" section (→  78)
- Please comply with the special mounting instructions when using pressure transmitters (→  41)

It is recommended to read in external measured values to calculate the following measured variables:

- Energy flow
- Mass flow
- Corrected volume flow

#### *HART protocol*

The measured values are written from the automation system to the measuring device via the HART protocol. The pressure transmitter must support the following protocol-specific functions:

- HART protocol
- Burst mode

#### *Current input*

The measured values are written from the automation system to the measuring device via the current input.

#### *Fieldbuses*

The measured values can be written from the automation system to the measuring via: PROFIBUS-PA

### **Current input**

<b>Current input</b>	4 to 20 mA (passive)
<b>Resolution</b>	1 $\mu$ A
<b>Voltage drop</b>	Typically: 2.2 to 3 V for 3.6 to 22 mA
<b>Maximum voltage</b>	$\leq 35$ V
<b>Possible input variables</b>	<ul style="list-style-type: none"> <li>■ Pressure</li> <li>■ Temperature</li> <li>■ Density</li> </ul>

## **Output**



### **Output signal**

#### **Current output**

<b>Current output 1</b>	4-20 mA HART (passive)
<b>Current output 2</b>	4-20 mA (passive)
<b>Resolution</b>	<1 $\mu$ A
<b>Damping</b>	Adjustable: 0.0 to 999.9 s
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>■ Volume flow</li> <li>■ Corrected volume flow</li> <li>■ Mass flow</li> <li>■ Flow velocity</li> <li>■ Temperature</li> <li>■ Calculated saturated steam pressure</li> <li>■ Total mass flow</li> <li>■ Energy flow</li> <li>■ Heat flow difference</li> </ul>

#### **Pulse/frequency/switch output**

<b>Function</b>	Can be set to pulse, frequency or switch output
<b>Version</b>	Passive, open collector

<b>Maximum input values</b>	<ul style="list-style-type: none"> <li>▪ DC 35 V</li> <li>▪ 50 mA</li> </ul> <p> For information on the Ex connection values (→  17)</p>
<b>Voltage drop</b>	<ul style="list-style-type: none"> <li>▪ For ≤2 mA: 2 V</li> <li>▪ For 10 mA: 8 V</li> </ul>
<b>Residual current</b>	≤0.05 mA
<b>Pulse output</b>	
<b>Pulse width</b>	Adjustable: 5 to 2 000 ms
<b>Maximum pulse rate</b>	100 Impulse/s
<b>Pulse value</b>	Adjustable
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>▪ Total volume flow</li> <li>▪ Total corrected volume flow</li> <li>▪ Total mass flow</li> <li>▪ Total energy flow</li> <li>▪ Total heat flow difference</li> </ul>
<b>Frequency output</b>	
<b>Output frequency</b>	Adjustable: 0 to 1 000 Hz
<b>Damping</b>	Adjustable: 0 to 999 s
<b>Pulse/pause ratio</b>	1:1
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>▪ Volume flow</li> <li>▪ Corrected volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Temperature</li> <li>▪ Calculated saturated steam pressure</li> <li>▪ Steam quality</li> <li>▪ Total mass flow</li> <li>▪ Energy flow</li> <li>▪ Heat flow difference</li> </ul>
<b>Switch output</b>	
<b>Switching behavior</b>	Binary, conductive or non-conductive
<b>Switching delay</b>	Adjustable: 0 to 100 s
<b>Number of switching cycles</b>	Unlimited
<b>Assignable functions</b>	<ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ On</li> <li>▪ Diagnostic behavior</li> <li>▪ Limit value <ul style="list-style-type: none"> <li>- Volume flow</li> <li>- Corrected volume flow</li> <li>- Mass flow</li> <li>- Flow velocity</li> <li>- Temperature</li> <li>- Calculated saturated steam pressure</li> <li>- Steam quality</li> <li>- Total mass flow</li> <li>- Energy flow</li> <li>- Heat flow difference</li> <li>- Reynolds number</li> <li>- Totalizer 1-3</li> </ul> </li> <li>▪ Status</li> <li>▪ Status of low flow cut off</li> </ul>

**PROFIBUS PA**

<b>Signal encoding</b>	Manchester Bus Powered (MBP)
<b>Data transfer</b>	31.25 KBit/s, Voltage mode

**Signal on alarm**

Depending on the interface, failure information is displayed as follows:

**Current output***HART*

<b>Device diagnostics</b>	Device condition can be read out via HART Command 48
---------------------------	--

**Pulse/frequency/switch output**

Pulse output	
<b>Failure mode</b>	No pulses
Frequency output	
<b>Failure mode</b>	Choose from: <ul style="list-style-type: none"> <li>▪ Actual value</li> <li>▪ Defined value: 0 to 1 250 Hz</li> <li>▪ 0 Hz</li> </ul>
Switch output	
<b>Failure mode</b>	Choose from: <ul style="list-style-type: none"> <li>▪ Current status</li> <li>▪ Open</li> <li>▪ Closed</li> </ul>

**PROFIBUS PA**

<b>Status and alarm messages</b>	Diagnostics in accordance with PROFIBUS PA Profile 3.02
<b>Error current FDE (Fault Disconnection Electronic)</b>	0 mA

**Local display**

<b>Plain text display</b>	With information on cause and remedial measures
<b>Backlight</b>	Additionally for device version with SD03 local display: red lighting indicates a device error.



Status signal as per NAMUR recommendation NE 107

**Operating tool**

- Via digital communication:
  - HART protocol
  - PROFIBUS PA
- Via service interface

<b>Plain text display</b>	With information on cause and remedial measures
---------------------------	---



Additional information on remote operation (→ 69)




**Load**

Load for current output: 0 to 500 Ω, depending on the external supply voltage of the power supply unit

**Calculation of the maximum load**

Depending on the supply voltage of the power supply unit ( $U_S$ ), the maximum load ( $R_B$ ) including line resistance must be observed to ensure adequate terminal voltage at the device. In doing so, observe the minimum terminal voltage ( $\rightarrow$  25)

- $R_B \leq (U_S - U_{\text{term. min}}) : 0.022 \text{ A}$
- $R_B \leq 500 \text{ } \Omega$

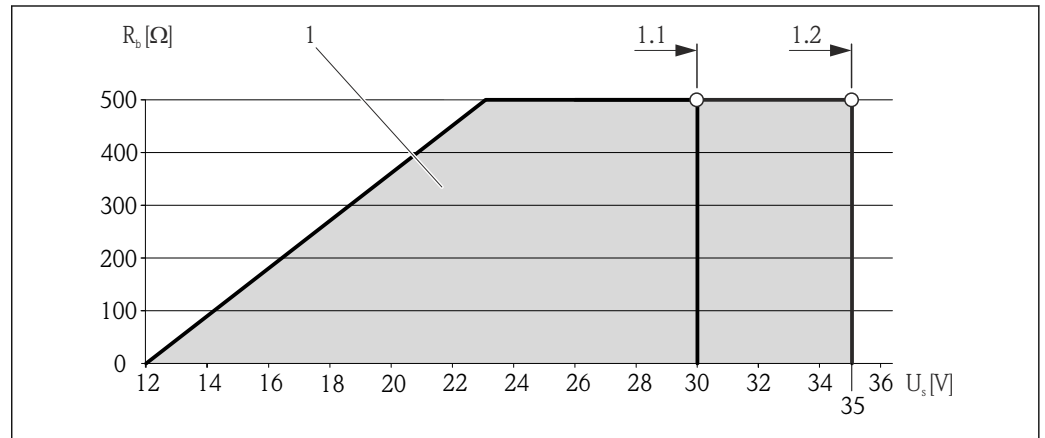

1 Load for a compact version without local operation

1 Operating range

1.1 For order code for "Output", option A "4-20 mA HART"/option B "4-20 mA HART, pulse/frequency/switch output" with Ex i and option C "4-20 mA HART, 4-20 mA"

1.2 For order code for "Output", option A "4-20 mA HART"/option B "4-20 mA HART, pulse/frequency/switch output" with non-Ex and Ex d

**Sample calculation**

Supply voltage of the supply unit:

-  $U_S = 19 \text{ V}$

-  $U_{\text{term. min}} = 12 \text{ V (measuring device)} + 1 \text{ V (local operation without lighting)} = 13 \text{ V}$

Maximum load:  $R_B \leq (19 \text{ V} - 13 \text{ V}) : 0.022 \text{ A} = 273 \text{ } \Omega$

**i** The minimum terminal voltage ( $U_{\text{term. min}}$ ) increases if local operation is used ( $\rightarrow$  26).

**Ex connection data**

**Safety-related values**

Ex d type of protection

Order code for "Output"	Output type	Safety-related values
Option A	4-20mA HART	$U_{\text{nom}} = \text{DC } 35 \text{ V}$ $U_{\text{max}} = 250 \text{ V}$
Option B	4-20mA HART	$U_{\text{nom}} = \text{DC } 35 \text{ V}$ $U_{\text{max}} = 250 \text{ V}$
	Pulse/frequency/switch output	$U_{\text{nom}} = \text{DC } 35 \text{ V}$ $U_{\text{max}} = 250 \text{ V}$ $P_{\text{max}} = 1 \text{ W}^{1)}$
Option C	4-20mA HART	$U_{\text{nom}} = \text{DC } 30 \text{ V}$
	4-20mA	$U_{\text{max}} = 250 \text{ V}$
Option D	4-20mA HART	$U_{\text{nom}} = \text{DC } 35 \text{ V}$ $U_{\text{max}} = 250 \text{ V}$

Order code for "Output"	Output type	Safety-related values
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W^{1)}$
	4 to 20 mA current input	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
Option G	PROFIBUS PA	$U_{nom} = DC 32 V$ $U_{max} = 250 V$ $P_{max} = 0.88 W$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W^{1)}$

1) Internal circuit limited by  $R_i = 760.5 \Omega$

*Ex nA type of protection*

Order code for "Output"	Output type	Safety-related values
Option A	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
Option B	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W^{1)}$
Option C	4-20mA HART	$U_{nom} = DC 30 V$ $U_{max} = 250 V$
	4-20mA	
Option D	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W$
	4 to 20 mA current input	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
Option G	PROFIBUS PA	$U_{nom} = DC 32 V$ $U_{max} = 250 V$ $P_{max} = 0.88 W$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W$

1) Internal circuit limited by  $R_i = 760.5 \Omega$

*Type of protection XP*

Order code for "Output"	Output type	Safety-related values
Option A	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
Option B	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W^{1)}$
Option C	4-20mA HART	$U_{nom} = DC 30 V$ $U_{max} = 250 V$
	4-20mA	

Order code for "Output"	Output type	Safety-related values
Option D	4-20mA HART	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W$
	4 to 20 mA current input	$U_{nom} = DC 35 V$ $U_{max} = 250 V$
Option G	PROFIBUS PA	$U_{nom} = DC 32 V$ $U_{max} = 250 V$ $P_{max} = 0.88 W$
	Pulse/frequency/switch output	$U_{nom} = DC 35 V$ $U_{max} = 250 V$ $P_{max} = 1 W$

1) Internal circuit limited by  $R_i = 760.5 \Omega$

### Intrinsically safe values

Type of protection *Ex ia*

Order code for "Output"	Output type	Intrinsically safe values
Option A	4-20mA HART	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 5 nF$
Option B	4-20mA HART	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 5 nF$
	Pulse/frequency/switch output	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 6 nF$
Option C	4-20mA HART	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 30 nF$
	4-20mA	
Option D	4-20mA HART	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 5 nF$
	Pulse/frequency/switch output	$U_i = DC 30 V$ $I_i = 300 mA$ $P_i = 1 W$ $L_i = 0 \mu H$ $C_i = 6 nF$

Order code for "Output"	Output type	Intrinsically safe values	
	4 to 20 mA current input	$U_i = \text{DC } 30 \text{ V}$ $I_i = 300 \text{ mA}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	
Option G	PROFIBUS PA	STANDARD $U_i = 30 \text{ V}$ $I_i = 300 \text{ mA}$ $P_i = 1.2 \text{ W}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	FISCO $U_i = 17.5 \text{ V}$ $I_i = 550 \text{ mA}$ $P_i = 5.5 \text{ W}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$

## Type of protection Ex ic

Order code for "Output"	Output type	Intrinsically safe values	
Option A	4-20mA HART	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	
Option B	4-20mA HART	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	
	Pulse/frequency/switch output	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	
Option C	4-20mA HART	$U_i = \text{DC } 30 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 30 \text{ nF}$	
	4-20mA		
Option D	4-20mA HART	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	
	Pulse/frequency/switch output	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	
	4 to 20 mA current input	$U_i = \text{DC } 35 \text{ V}$ $I_i = \text{n.a.}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	
Option G	PROFIBUS PA	STANDARD $U_i = 32 \text{ V}$ $I_i = 300 \text{ mA}$ $P_i = \text{n.a.}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$	FISCO $U_i = 17.5 \text{ V}$ $I_i = \text{n.a.}$ $P_i = \text{n.a.}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$
	Pulse/frequency/switch output	$U_i = 35 \text{ V}$ $I_i = 300 \text{ mA}$ $P_i = 1 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	

*IS type of protection*

Order code for "Output"	Output type	Intrinsically safe values	
Option A	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
Option B	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
	Pulse/frequency/switch output	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	
Option C	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 30\ nF$	
	4-20mA		
Option D	4-20mA HART	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
	Pulse/frequency/switch output	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	
	4 to 20 mA current input	$U_i = DC\ 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 5\ nF$	
Option G	PROFIBUS PA	STANDARD $U_i = 30\ V$ $I_i = 300\ mA$ $P_i = 1.2\ W$ $L_i = 10\ \mu H$ $C_i = 5\ nF$	FISCO $U_i = 17.5\ V$ $I_i = 550\ mA$ $P_i = 5.5\ W$ $L_i = 10\ \mu H$ $C_i = 5\ nF$
	Pulse/frequency/switch output	$U_i = 30\ V$ $I_i = 300\ mA$ $P_i = 1\ W$ $L_i = 0\ \mu H$ $C_i = 6\ nF$	

**Low flow cut off** The switch points for low flow cut off are user-selectable.

**Galvanic isolation** All outputs are galvanically isolated from one another.

**Protocol-specific data** HART

Manufacturer ID	0x11
Device type ID	0x38
HART protocol revision	7

<b>Device description files (DTM, DD)</b>	Information and files under: <a href="http://www.endress.com">www.endress.com</a>
<b>HART load</b>	<ul style="list-style-type: none"> <li>▪ Min. 250 Ω</li> <li>▪ Max. 500 Ω</li> </ul>
<b>Dynamic variables</b>	<p>The measured variables can be freely assigned to the dynamic variables.</p> <p><b>Measured variables for PV (primary dynamic variable)</b></p> <ul style="list-style-type: none"> <li>▪ Volume flow</li> <li>▪ Corrected volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Temperature</li> <li>▪ Calculated saturated steam pressure</li> <li>▪ Steam quality</li> <li>▪ Total mass flow</li> <li>▪ Energy flow</li> <li>▪ Heat flow difference</li> </ul> <p><b>Measured variables for SV, TV, QV (secondary, tertiary and quaternary dynamic variable)</b></p> <ul style="list-style-type: none"> <li>▪ Volume flow</li> <li>▪ Corrected volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Temperature</li> <li>▪ Calculated saturated steam pressure</li> <li>▪ Steam quality</li> <li>▪ Total mass flow</li> <li>▪ Energy flow</li> <li>▪ Heat flow difference</li> <li>▪ Condensate mass flow</li> <li>▪ Reynolds number</li> <li>▪ Totalizer 1</li> <li>▪ Totalizer 2</li> <li>▪ Totalizer 3</li> <li>▪ HART input</li> </ul>
<b>Device variables</b>	<p>Readout the device variables: HART command 9 The device variables are fixed assigned.</p> <p>Maximum 8 device variables can be transmitted:</p> <ul style="list-style-type: none"> <li>▪ 0 = Volume flow</li> <li>▪ 1 = Corrected volume flow</li> <li>▪ 2 = Mass flow</li> <li>▪ 3 = Flow velocity</li> <li>▪ 4 = Temperature</li> <li>▪ 5 = Calculated saturated steam pressure</li> <li>▪ 6 = Steam quality</li> <li>▪ 7 = Total mass flow</li> <li>▪ 8 = Energy flow</li> <li>▪ 9 = Heat flow difference</li> <li>▪ 10 = Condensate mass flow</li> <li>▪ 11 = Reynolds number</li> <li>▪ 12 = Totalizer value 1</li> <li>▪ 13 = Totalizer value 2</li> <li>▪ 14 = Totalizer value 3</li> </ul>

**PROFIBUS PA**

<b>Manufacturer ID</b>	0x11
<b>Ident number</b>	0x1564
<b>Profile version</b>	3.02
<b>Device description files (GSD, DTM, DD)</b>	Information and files under: <ul style="list-style-type: none"> <li>▪ <a href="http://www.endress.com">www.endress.com</a></li> <li>▪ <a href="http://www.profibus.org">www.profibus.org</a></li> </ul>

<p><b>Output values</b> (from measuring device to automation system)</p>	<p><b>Analog input 1 to 4</b></p> <ul style="list-style-type: none"> <li>▪ Mass flow</li> <li>▪ Volume flow</li> <li>▪ Corrected volume flow</li> <li>▪ Density</li> <li>▪ Reference density</li> <li>▪ Temperature</li> </ul> <p><b>Digital input 1 to 2</b></p> <ul style="list-style-type: none"> <li>▪ Status</li> <li>▪ Low flow cut off</li> <li>▪ Switch output</li> </ul> <p><b>Totalizer 1 to 3</b></p> <ul style="list-style-type: none"> <li>▪ Mass flow</li> <li>▪ Volume flow</li> <li>▪ Corrected volume flow</li> </ul>
<p><b>Input values</b> (from automation system to measuring device)</p>	<p><b>Analog output</b> External pressure, gage pressure, density, temperature or second temperature (for delta heat measurement)</p> <p><b>Digital output 1 to 3 (fixed assignment)</b></p> <ul style="list-style-type: none"> <li>▪ Digital output 1: switch positive zero return on/off</li> <li>▪ Digital output 2: switch switch output on/off</li> <li>▪ Digital output 3: Start verification</li> </ul> <p><b>Totalizer 1 to 3</b></p> <ul style="list-style-type: none"> <li>▪ Totalize</li> <li>▪ Reset and hold</li> <li>▪ Preset and hold</li> </ul>
<p><b>Supported functions</b></p>	<ul style="list-style-type: none"> <li>▪ Identification &amp; Maintenance Simplest device identification on the part of the control system and nameplate</li> <li>▪ PROFIBUS upload/download Reading and writing parameters is up to ten times faster with PROFIBUS upload/download</li> <li>▪ Condensed status Simplest and self-explanatory diagnostic information by categorizing diagnostic messages that occur</li> </ul>
<p><b>Configuration of the device address</b></p>	<ul style="list-style-type: none"> <li>▪ DIP switches on the I/O electronics module</li> <li>▪ Local display</li> <li>▪ Via operating tools (e.g. FieldCare)</li> </ul>

## Power supply

### Terminal assignment

### Transmitter

#### Connection versions

<p style="text-align: right; font-size: small;">A0020738</p>	<p style="text-align: right; font-size: small;">A0020739</p>
<p>Maximum number of terminals Terminals 1 to 6: Without integrated overvoltage protection</p>	<p>Maximum number of terminals for order code for "Accessory mounted", option NA "Overvoltage protection"</p> <ul style="list-style-type: none"> <li>■ Terminals 1 to 4: With integrated overvoltage protection</li> <li>■ Terminals 5 to 6: Without integrated overvoltage protection</li> </ul>
<p>1 Output 1 (passive): supply voltage and signal transmission                  2 Output 2 (passive): supply voltage and signal transmission                  3 Input (passive): supply voltage and signal transmission                  4 Ground terminal for cable shield</p>	

Order code for "Output"	Terminal numbers					
	Output 1		Output 2		Input	
	1 (+)	2 (-)	3 (+)	4 (-)	5 (+)	6 (-)
Option A	4-20 mA HART (passive)		-		-	
Option B <sup>1)</sup>	4-20 mA HART (passive)		Pulse/frequency/switch output (passive)		-	
Option C <sup>1)</sup>	4-20 mA HART (passive)		4-20 mA (passive)		-	
Option D <sup>1) 2)</sup>	4-20 mA HART (passive)		Pulse/frequency/switch output (passive)		4-20 mA current input (passive)	
Option G <sup>1) 3)</sup>	PROFIBUS PA		Pulse/frequency/switch output (passive)		-	

- 1) Output 1 must always be used; output 2 is optional.
- 2) The integrated overvoltage protection is not used with option D: Terminals 5 and 6 (current input) are not protected against overvoltage.
- 3) PROFIBUS PA with integrated reverse polarity protection.

#### Remote version

In the case of the remote version, the sensor and transmitter are mounted separately from one another and connected by a connecting cable. The sensor is connected via the connection housing while the transmitter is connected via the connection compartment of the wall holder unit.


**i** The way the transmitter wall holder is connected depends on the measuring device approval and the version of the connecting cable used.

- Connection is only possible via terminals:
- For approvals Ex n, Ex tb and cCSAus Div. 1
  - If a reinforced connecting cable is used

- The connection is via an M12 connector:
- For all other approvals
  - If the standard connecting cable is used

Connection to the connection housing of the sensor is always via terminals.



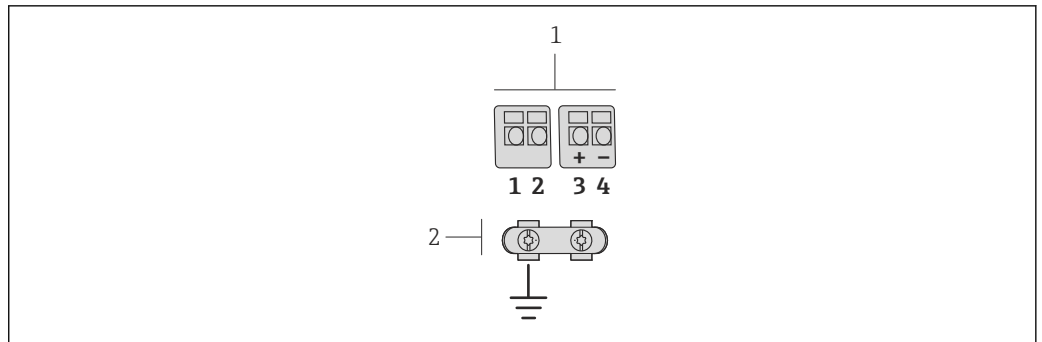

A0019335

- 2 Terminals for connection compartment in the transmitter wall holder and the sensor connection housing
- 1 Terminals for connecting cable
- 2 Grounding via the cable strain relief

Terminal number	Assignment	Cable color Connecting cable
1	Supply voltage	Brown
2	Grounding	White
3	RS485 (+)	Yellow
4	RS485 (-)	Green

**Pin assignment, device plug PROFIBUS PA**

Device plug for signal transmission (device side)

Pin	Assignment		Coding	Plug/socket
	Pin	Assignment		
1	+	PROFIBUS PA +	A	Plug
2		Grounding		
3	-	PROFIBUS PA -		
4		Not assigned		

**Supply voltage**

**Transmitter**

An external power supply is required for each output.

Supply voltage for a compact version without a local display<sup>1)</sup>

Order code for "Output"	Minimum terminal voltage <sup>2)</sup>	Maximum terminal voltage
Option A: 4-20 mA HART	≥DC 12 V	DC 35 V
Option B: 4-20 mA HART, pulse/frequency/switch output	≥DC 12 V	DC 35 V
Option C: 4-20 mA HART, 4-20 mA	≥DC 12 V	DC 30 V
Option D: 4-20 mA HART, pulse/frequency/switch output, 4-20 mA current input <sup>3)</sup>	≥DC 12 V	DC 35 V
Option G: PROFIBUS PA, pulse/frequency/switch output	≥DC 9 V	DC 32 V

- 1) In event of external supply voltage of the power supply unit with load
- 2) The minimum terminal voltage increases if local operation is used: see the following table
- 3) Voltage drop 2.2 to 3 V for 3.59 to 22 mA

*Increase in minimum terminal voltage*

Local operation	Increase in minimum terminal voltage
Order code for "Display; Operation", option C: Local operation SD02	+ DC 1 V
Order code for "Display; Operation", option E: Local operation SD03 with lighting (backlighting <b>not used</b> )	+ DC 1 V
Order code for "Display; Operation", option E: Local operation SD03 with lighting (backlighting <b>used</b> )	+ DC 3 V



For information about the load see (→ 17)



Various power supply units can be ordered from Endress+Hauser: see "Accessories" section (→ 78)



For information on the Ex connection values (→ 17)

**Power consumption****Transmitter**

Order code for "Output"	Maximum power consumption
Option A: 4-20 mA HART	770 mW
Option B: 4-20 mA HART, pulse/ frequency/switch output	<ul style="list-style-type: none"> <li>▪ Operation with output 1: 770 mW</li> <li>▪ Operation with output 1 and 2: 2 770 mW</li> </ul>
Option C: 4-20 mA HART, 4-20 mA	<ul style="list-style-type: none"> <li>▪ Operation with output 1: 660 mW</li> <li>▪ Operation with output 1 and 2: 1 320 mW</li> </ul>
Option D: 4-20 mA HART, pulse/ frequency/switch output, 4-20 mA current input	<ul style="list-style-type: none"> <li>▪ Operation with output 1: 770 mW</li> <li>▪ Operation with output 1 and 2: 2 770 mW</li> <li>▪ Operation with output 1 and input: 840 mW</li> <li>▪ Operation with output 1, 2 and input: 2 840 mW</li> </ul>
Option G: PROFIBUS PA, pulse/frequency/ switch output	<ul style="list-style-type: none"> <li>▪ Operation with output 1: 512 mW</li> <li>▪ Operation with output 1 and 2: 2 512 mW</li> </ul>



For information on the Ex connection values (→ 17)

**Current consumption****Current output**

For every 4-20 mA or 4-20 mA HART current output: 3.6 to 22.5 mA



If the option **Defined value** is selected in the **Failure mode** parameter (→ 16):  
3.59 to 22.5 mA

**Current input**

3.59 to 22.5 mA



Internal current limiting: max. 26 mA

**PROFIBUS PA**


15 mA

**Power supply failure**

- Totalizers stop at the last value measured.
- Configuration is retained in the device memory (HistoROM).
- Error messages (incl. total operated hours) are stored.

Electrical connection

Connecting the transmitter

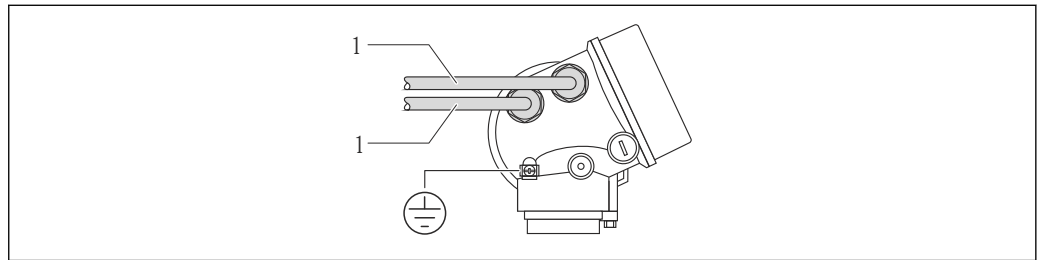


A0020740

1 Cable entries for inputs/outputs

Remote version connection

Connecting cable

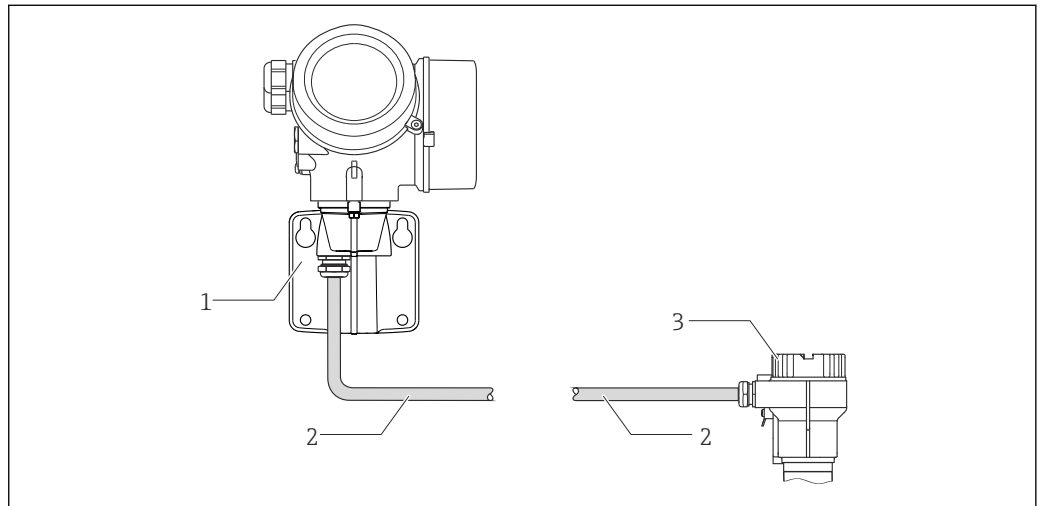

A0019727

3 Connecting cable connection

- 1 Wall holder with connection compartment (transmitter)
- 2 Connecting cable
- 3 Sensor connection housing

**i** The way the transmitter wall holder is connected depends on the measuring device approval and the version of the connecting cable used.

Connection is only possible via terminals:

- For approvals Ex n, Ex tb and cCSAus Div. 1
- If a reinforced connecting cable is used


The connection is via an M12 connector:

- For all other approvals
- If the standard connecting cable is used

Connection to the connection housing of the sensor is always via terminals.

## Connection examples

### Current output 4-20 mA HART

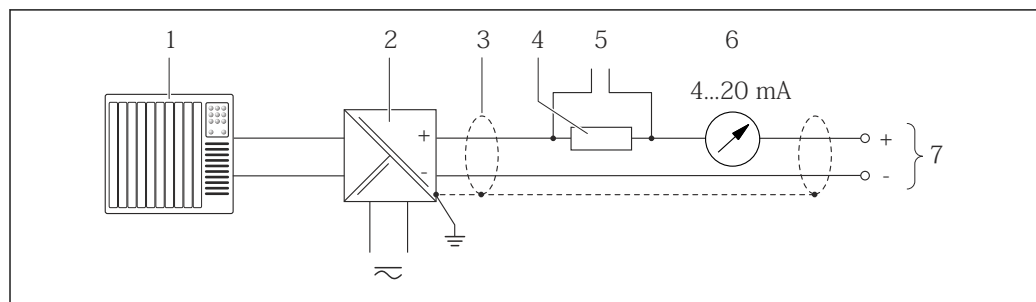


A0015511

4 Connection example for 4-20 mA HART current output (passive)

- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N) (→ 31)
- 3 Cable shield, observe cable specifications (→ 31)
- 4 Resistor for HART communication ( $\geq 250 \Omega$ ): observe maximum load (→ 17)
- 5 Connection for HART operating devices (→ 69)
- 6 Analog display unit: observe maximum load (→ 17)
- 7 Transmitter

### Current output 4-20 mA

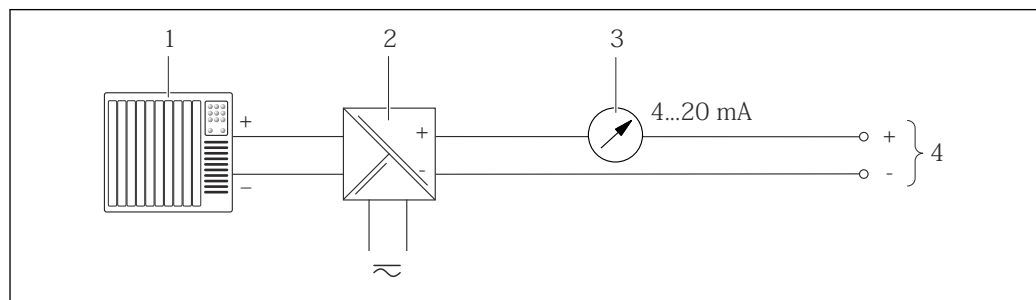


A0015512

5 Connection example for 4-20 mA current output (passive)

- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N) (→ 25)
- 3 Analog display unit: observe maximum load (→ 17)
- 4 Transmitter

Pulse/frequency output

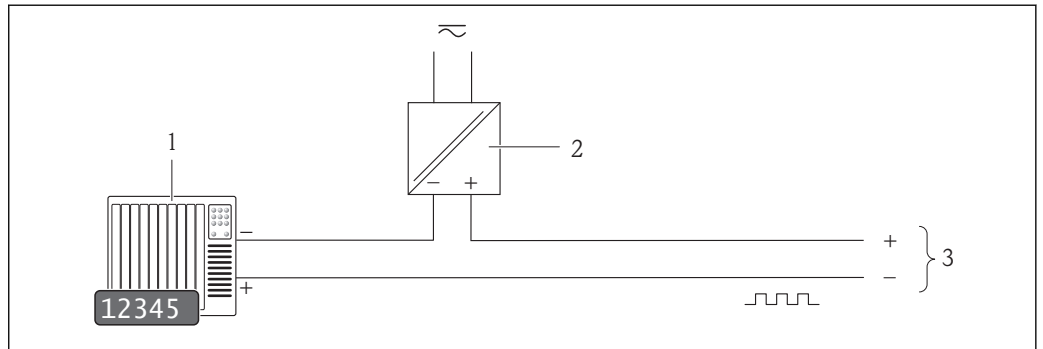


A0016801

6 Connection example for pulse/frequency output (passive)

- 1 Automation system with pulse/frequency input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: observe input values (→ 14)

Switch output

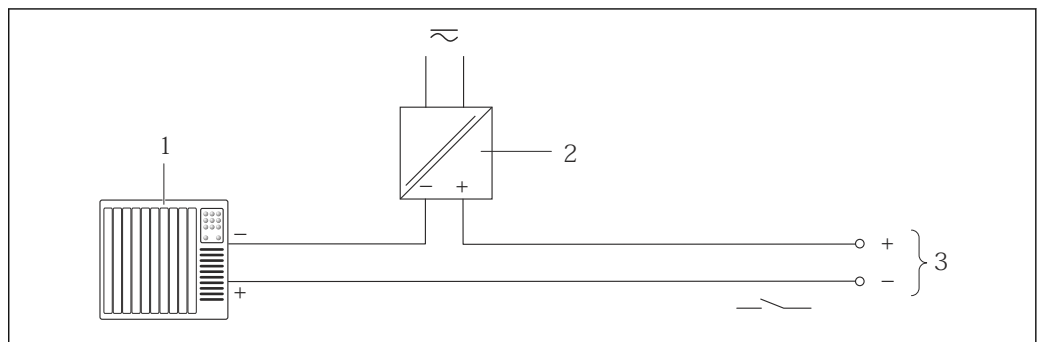


A0016802

7 Connection example for switch output (passive)

- 1 Automation system with switch input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: observe input values (→ 14)

PROFIBUS-PA

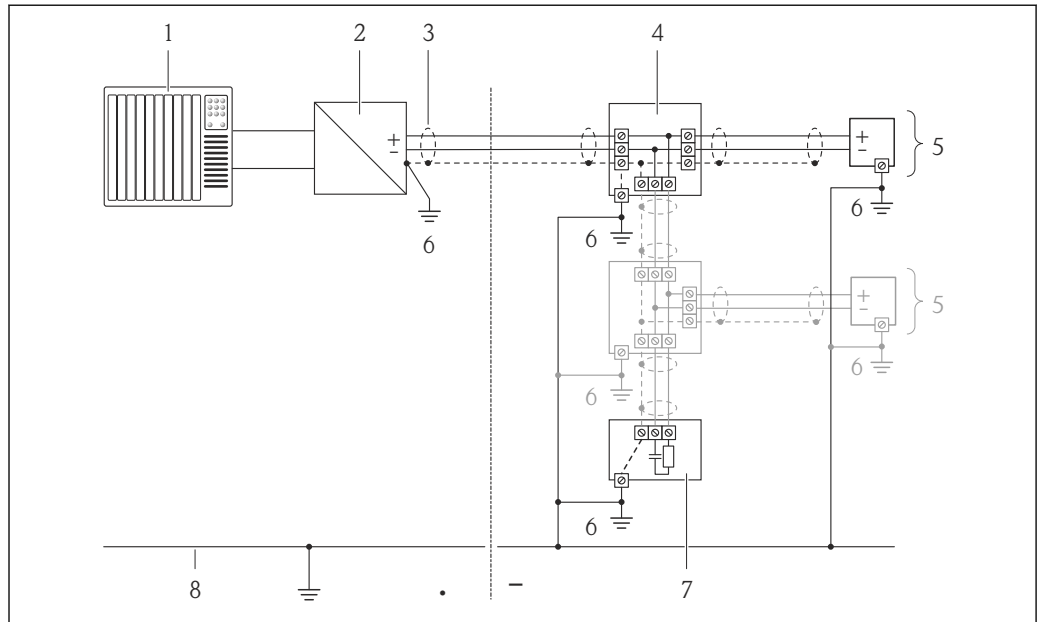


A0019004

8 Connection example for PROFIBUS-PA

- 1 Control system (e.g. PLC)
- 2 Segment coupler PROFIBUS DP/PA
- 3 Cable shield
- 4 T-box
- 5 Measuring device
- 6 Local grounding
- 7 Bus terminator
- 8 Potential matching line

Current input

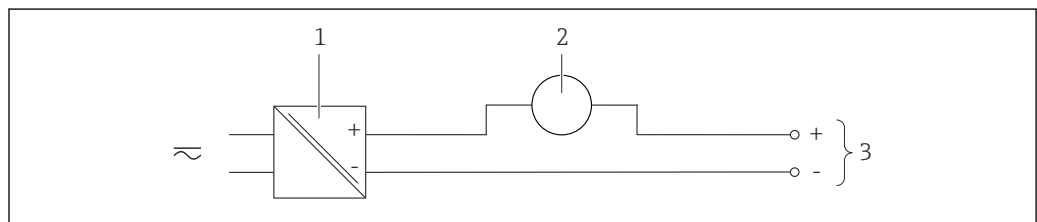


A0020741

9 Connection example for 4-20 mA current input

- 1 Power supply
- 2 External measuring device (for reading in pressure or temperature, for instance)
- 3 Transmitter: observe input values (→ 14)

HART input

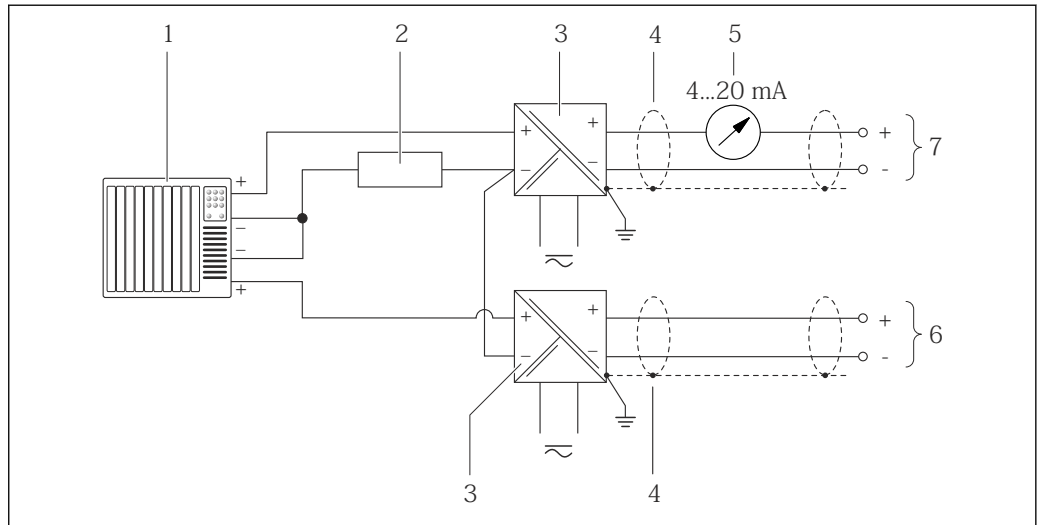

A0016029

10 Connection example for HART input with a common negative

- 1 Automation system with HART output (e.g. PLC)
- 2 Resistor for HART communication ( $\geq 250 \Omega$ ): observe maximum load ( $\rightarrow$  17)
- 3 Active barrier for power supply (e.g. RN221N) ( $\rightarrow$  25)
- 4 Cable shield, observe cable specifications ( $\rightarrow$  31)
- 5 Analog display unit: observe maximum load ( $\rightarrow$  17)
- 6 Pressure transmitter (e.g. Cerabar M, Cerabar S): see requirements ( $\rightarrow$  13)
- 7 Transmitter

Potential equalization

Requirements

Please consider the following to ensure correct measurement:

- Same electrical potential for the fluid and sensor
- Remote version: same electrical potential for the sensor and transmitter
- Company-internal grounding concepts
- Pipe material and grounding

For devices intended for use in hazardous locations, please observe the guidelines in the Ex documentation (XA).

Terminals

- For device version without integrated overvoltage protection: plug-in spring terminals for wire cross-sections 0.5 to 2.5 mm<sup>2</sup> (20 to 14 AWG)
- For device version with integrated overvoltage protection: screw terminals for wire cross-sections 0.2 to 2.5 mm<sup>2</sup> (24 to 14 AWG)

Cable entries

- Cable gland (not for Ex d): M20  $\times$  1.5 with cable  $\phi$ 6 to 12 mm (0.24 to 0.47 in)
- Thread for cable entry:
  - For non-Ex and Ex: NPT 1/2"
  - For non-Ex and Ex (not for CSA Ex d/XP): G 1/2"
  - For Ex d: M20  $\times$  1.5

Cable specification

Permitted temperature range

- -40 °C (-40 °F) to +80 °C (+176 °F)
- Minimum requirement: cable temperature range  $\geq$  ambient temperature +20 K

Signal cable

Current output

For 4-20 mA HART: Shielded cable recommended. Observe grounding concept of the plant.

Pulse/frequency/switch output

Standard installation cable is sufficient.

*Current input*

Standard installation cable is sufficient.

*PROFIBUS PA*

Twisted, shielded two-wire cable. Cable type A is recommended.



For further information on planning and installing PROFIBUS PA networks see:

- Operating Instructions "PROFIBUS DP/PA: Guidelines for planning and commissioning" (BA00034S)
- PNO Directive 2.092 "PROFIBUS PA User and Installation Guideline"
- IEC 61158-2 (MBP)

**Connecting cable for remote version***Connecting cable (standard)*


<b>Standard cable</b>	4 × 2 × 0.34 mm <sup>2</sup> (22 AWG) PVC cable with common shield (4 pairs, pair-stranded)
<b>Flame resistance</b>	According to DIN EN 60332-1-2
<b>Oil-resistance</b>	According to DIN EN 60811-2-1
<b>Shielding</b>	Galvanized copper-braid, opt. density approx. 85%
<b>Cable length</b>	5 m (16 ft), 10 m (32 ft), 20 m (65 ft), 30 m (98 ft)
<b>Operating temperature</b>	When mounted in a fixed position: -50 to +105 °C (-58 to +221 °F); when cable can move freely: -25 to +105 °C (-13 to +221 °F)

*Connecting cable (reinforced)*

<b>Cable, reinforced</b>	4 × 2 × 0.34 mm <sup>2</sup> (22 AWG) PVC cable with common shield (4 pairs, pair-stranded) and additional steel-wire braided sheath
<b>Flame resistance</b>	According to DIN EN 60332-1-2
<b>Oil-resistance</b>	According to DIN EN 60811-2-1
<b>Shielding</b>	Galvanized copper-braid, opt. density approx. 85%
<b>Strain relief and reinforcement</b>	Steel-wire braid, galvanized
<b>Cable length</b>	5 m (16 ft), 10 m (32 ft), 20 m (65 ft), 30 m (98 ft)
<b>Operating temperature</b>	When mounted in a fixed position: -50 to +105 °C (-58 to +221 °F); when cable can move freely: -25 to +105 °C (-13 to +221 °F)


**Overvoltage protection**

The device can be ordered with integrated overvoltage protection for diverse approvals:  
*Order code for "Accessory mounted", option NA "Overvoltage protection"*

<b>Input voltage range</b>	Values correspond to supply voltage specifications (→  25) <sup>1)</sup>
<b>Resistance per channel</b>	2 · 0.5 Ω max
<b>DC sparkover voltage</b>	400 to 700 V
<b>Trip surge voltage</b>	<800 V
<b>Capacitance at 1 MHz</b>	<1.5 pF
<b>Nominal discharge current (8/20 μs)</b>	10 kA
<b>Temperature range</b>	-40 to +85 °C (-40 to +185 °F)

1) The voltage is reduced by the amount of the internal resistance  $I_{min} \cdot R_i$



**i** Depending on the temperature class, restrictions apply to the ambient temperature for device versions with overvoltage protection (→  41)

## Performance characteristics

### Reference operating conditions

- Error limits following ISO/DIN 11631
- +20 to +30 °C (+68 to +86 °F)
- 2 to 4 bar (29 to 58 psi)
- Calibration system traceable to national standards
- Calibration with the process connection corresponding to the particular standard

**i** To obtain measured errors, use the *Applicator* sizing tool (→  78)


### Maximum measured error

#### Base accuracy

o.r. = of reading; o.f.s. = of full scale value, Re = Reynolds number

#### Volume flow

The measured error for the volume flow is as follows depending on the Reynolds number and the compressibility of the medium under measurement:

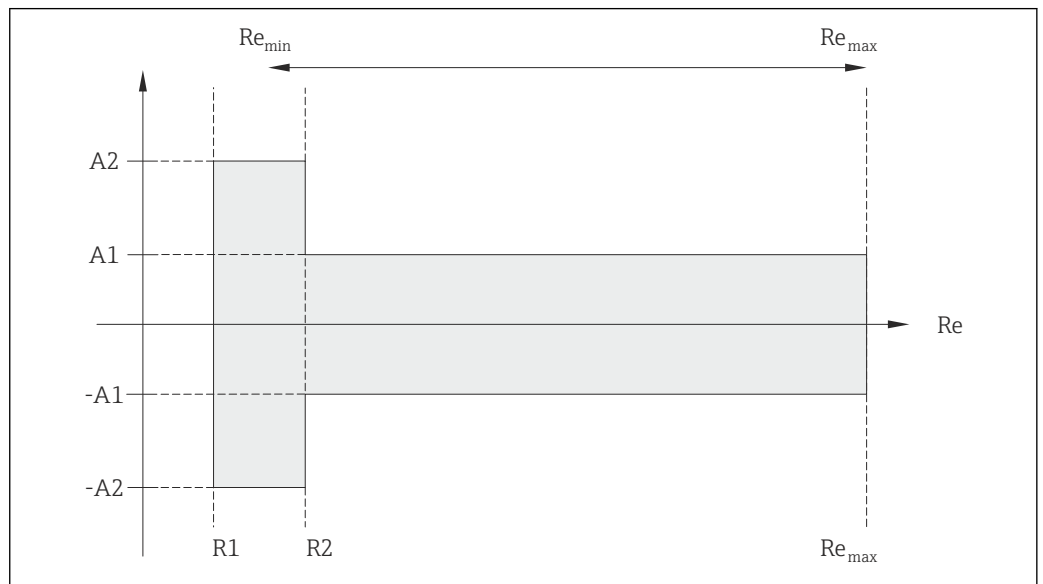

A0019703

Deviation of volume flow value (absolute) from the reading			
Medium type		Incompressible	Compressible <sup>1)</sup>
Re range	Measured value deviation	Standard	Standard
R1 to R2	A2	< 10 %	< 10 %
R2 to Re <sub>max</sub>	A1	< 0.75 %	< 1.0 %

1) Accuracy specifications valid up to 75 m/s (246 ft/s)

Reynolds numbers	Incompressible	Compressible
	Standard	Standard
R1	5 000	
R2	20 000	

**Temperature**

- Saturated steam and liquids at room temperature if  $T > 100\text{ °C}$  (212 °F) applies:  $< 1\text{ °C}$  (1.8 °F)
- Gas:  $< 1\text{ % o.r. [K]}$

Rise time 50 % (stirred under water, following IEC 60751): 8 s

**Mass flow (saturated steam)**

- Flow velocities 20 to 50 m/s (66 to 164 ft/s),  $T > 150\text{ °C}$  (302 °F) or (423 K)
  - Re  $> 20\,000$ :  $< 1.7\text{ % o.r.}$
  - Re between 5 000 to 20 000:  $< 1.7\text{ % o.f.s.}$
- Flow velocities 10 to 70 m/s (33 to 210 ft/s),  $T > 140\text{ °C}$  (284 °F) or (413 K)
  - Re  $> 20\,000$ :  $< 2\text{ % o.r.}$
  - Re between 5 000 to 20 000:  $< 2\text{ % o.f.s.}$



The use of a Cerabar S is required for the measured errors listed in the following section. The measured error used to calculate the error in the measured pressure is 0.15%.

**Mass flow of superheated steam and gas (single gas, gas mixture, air: NEL40; natural gas: ISO 12213-2 contains AGA8-DC92, AGA NX-19, ISO 12213-3 contains SGERG-88 and AGA8 Gross Method 1)**

- Re  $> 20\,000$  and process pressure  $< 40\text{ bar}$  (580 psi) abs: 1.7 % o.r.
- Re between 5 000 to 20 000 and process pressure  $< 40\text{ bar}$  (580 psi) abs: 1.7 % o.f.s.
- Re  $> 20\,000$  and process pressure  $< 120\text{ bar}$  (1 740 psi) abs: 2.6 % o.r.
- Re between 5 000 to 20 000 and process pressure  $< 120\text{ bar}$  (1 740 psi) abs: 2.6 % o.f.s.

**Mass flow (water)**

- Re 20 000:  $< 0.85\text{ % o.r.}$
- Re between 5 000 to 20 000:  $< 0.85\text{ % o.f.s.}$

**Mass flow (user-defined liquids)**

To specify the system accuracy, Endress+Hauser requires information about the type of liquid and its operating temperature or information in table form about the dependency between the liquid density and the temperature.

*Example*

- Acetone is to be measured at fluid temperatures between  $+70$  to  $+90\text{ °C}$  ( $+158$  to  $+194\text{ °F}$ ).
- For this purpose the **Reference temperature** parameter (here  $80\text{ °C}$  ( $176\text{ °F}$ )), **Reference density** parameter (here  $720.00\text{ kg/m}^3$ ) and **Linear expansion coefficient** parameter (here  $18.0298 \times 10E-4\text{ 1/°C}$ ) must be entered in the transmitter.
- The overall system uncertainty, which is smaller than 0.9 % for the example above, is comprised of the following uncertainties of measurement: uncertainty of volume flow measurement, uncertainty of temperature measurement, uncertainty of the density-temperature correlation used (incl. the resulting uncertainty of density).

**Mass flow (other media)**

Depends on the selected fluid and the pressure value, which is specified in the parameters. Individual error analysis must be performed.

**Diameter mismatch correction**

Prowirl 200 can correct shifts in the calibration factor which are caused, for example, by diameter mismatch between the device flange (e.g. ASME B16.5/Sch. 80, DN 50 (2")) and the mating pipe (e.g. ASME B16.5/Sch. 40, DN 50 (2")). Only apply diameter mismatch correction within the following limit values (listed below) for which test measurements have also been performed.

**Disc (wafer flange):**

- DN 15 (½"):  $\pm 15\text{ %}$  of the internal diameter
- DN 25 (1"):  $\pm 12\text{ %}$  of the internal diameter
- DN 40 (1½"):  $\pm 9\text{ %}$  of the internal diameter
- DN  $\geq 50$  (2"):  $\pm 8\text{ %}$  of the internal diameter

If the standard internal diameter of the ordered process connection differs from the internal diameter of the mating pipe, an additional measuring uncertainty of approx. 2 % o.r. must be expected.

**Example**

Influence of the diameter mismatch without using the correction function:

- Mating pipe DN 100 (4"), schedule 80
- Device flange DN 100 (4"), schedule 40
- This installation position results in a diameter mismatch of 5 mm (0.2 in). If the correction function is not used, an additional measuring uncertainty of approx. 2 % o.r. must be expected.

 For detailed information about diameter mismatch correction, refer to the Operating Instructions (→  79)

**Accuracy of outputs**

o.r. = of reading

*Current output*

<b>Accuracy</b>	±10 µA
-----------------	--------

*Pulse/frequency output*

<b>Accuracy</b>	Max. ±100 ppm o.r.
-----------------	--------------------

**Repeatability**

o.r. = of reading

±0.2 % o.r.

**Response time**

If all the configurable functions for filter times (flow damping, display damping, current output time constant, frequency output time constant, status output time constant) are set to 0, in the event of vortex frequencies of 10 Hz and higher a response time of  $\max(T_v, 100 \text{ ms})$  can be expected.

In the event of measuring frequencies < 10 Hz, the response time is > 100 ms and can be up to 10 s.  $T_v$  is the average vortex period duration of the flowing fluid.

**Influence of ambient temperature**

o.r. = of reading

**Current output**

Additional error, in relation to the span of 16 mA:

<b>Temperature coefficient at zero point (4 mA)</b>	0.02 %/10 K
<b>Temperature coefficient with span (20 mA)</b>	0.05 %/10 K


**Pulse/frequency output**

<b>Temperature coefficient</b>	Max. ±100 ppm o.r.
--------------------------------	--------------------

**Installation**

No special measures such as supports are necessary. External forces are absorbed by the construction of the device.

**Mounting location**

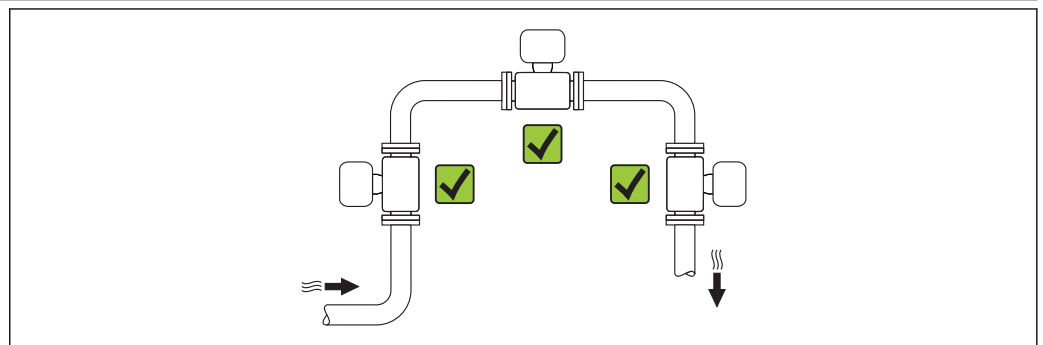

A0015543

**Orientation**

Vortex meters require a fully developed flow profile as a prerequisite for correct volume flow measurement.

The direction of the arrow on the sensor nameplate helps you to install the sensor according to the flow direction (direction of medium flow through the piping).

The device can basically be installed in any orientation in the pipe. However, note the following points:


Orientation		Compact version	Remote version
A	Vertical orientation	✓✓ <sup>1)</sup>	✓✓
B	Horizontal orientation, transmitter head up	✓✓ <sup>2) 3)</sup>	✓✓
C	Horizontal orientation, transmitter head down	✓✓ <sup>4) 5)</sup>	✓✓
D	Horizontal orientation, transmitter head at side	✓✓ <sup>4)</sup>	✓✓

- 1) In the case of liquids, there should be upward flow in vertical pipes to avoid partial pipe filling (Fig. A). Disruption in flow measurement! In the case of vertical orientation and downward flowing liquid, the pipe always needs to be completely filled to ensure correct liquid flow measurement.
- 2) Danger of electronics overheating! If the fluid temperature is  $\geq 200\text{ °C}$  (392 °F) orientation B is not permitted for the wafer version (Prowirl D) with nominal diameters DN 100 (4") and DN 150 (6").
- 3) In the case of hot media (e.g. steam or fluid temperature (TM)  $\geq 200\text{ °C}$  (392 °F): orientation C or D
- 4) In the case of very cold media (e.g. liquid nitrogen): orientation B or D
- 5) For "wet steam detection" option: orientation C

**Minimum spacing and cable length**

The following dimensions must be observed to guarantee problem-free access to the device for service purposes:

- Minimum spacing (A) in all directions = 100 mm (3.94 in)
- Necessary cable length (L):  $L + 150\text{ mm}$  (5.91 in)

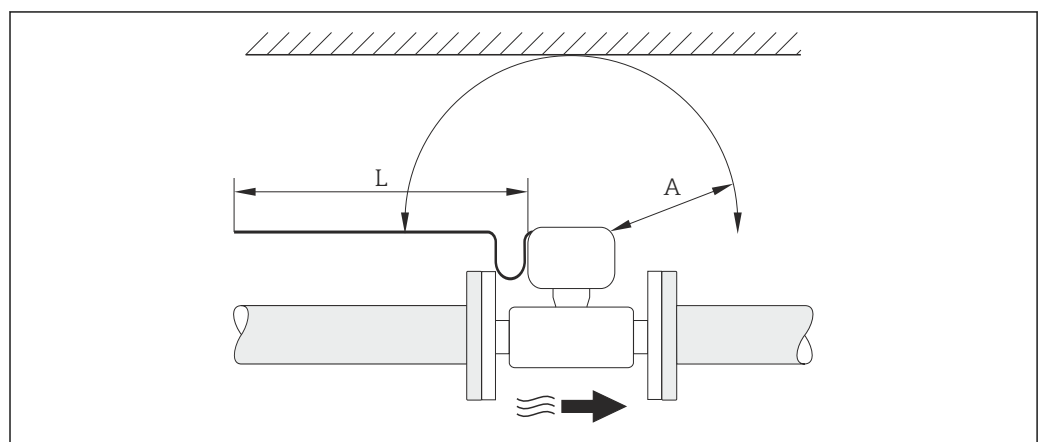

- A Minimum spacing in all directions  
L Required cable length


A0019211

### Rotating the electronics housing and the display

The electronics housing can be rotated continuously by 360° on the housing support. The display unit can be rotated in 45° stages. This means you can read the display comfortably from all directions.

### Inlet and outlet runs

To attain the specified level of accuracy of the measuring device, the inlet and outlet runs mentioned below must be maintained at the very minimum. If there are several flow disturbances present, the longest specified inlet run must be maintained.

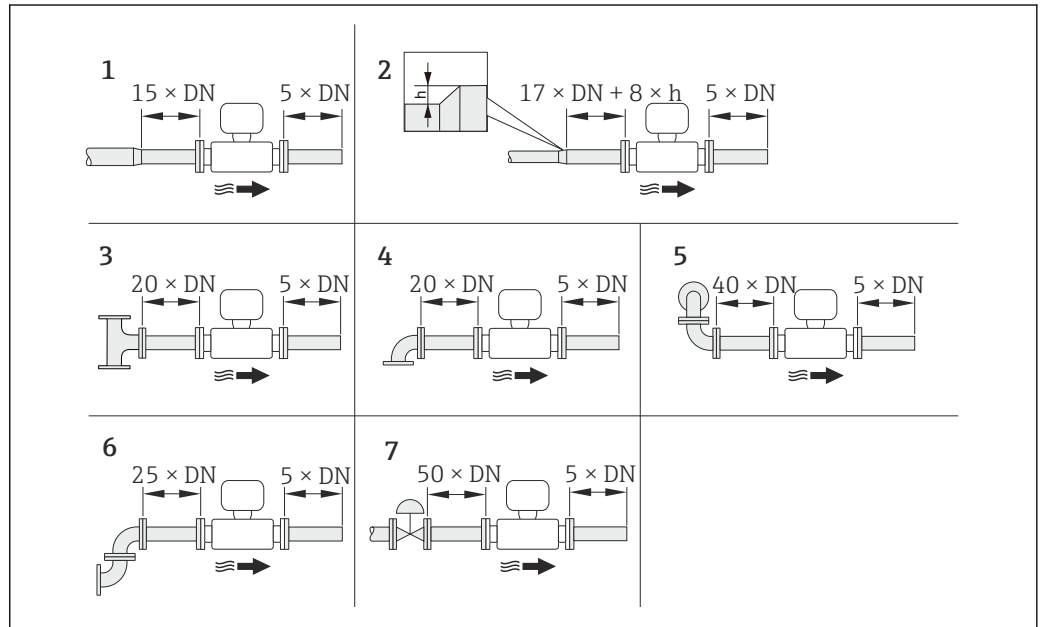

A0019189

11 Minimum inlet and outlet runs with various flow obstructions

*h* Difference in expansion

1 Reduction by one nominal diameter size

2 Expansion

3 T-piece

4 Single elbow (90° elbow)

5 Double elbow 3D (2 × 90° elbows, opposite, not on one plane)


6 Double elbow (2 × 90° elbows, opposite)

7 Control valve

**i** If the required inlet runs cannot be observed, it is possible to install a specially designed flow conditioner (→ 41).

### Flow conditioner

If the required inlet runs cannot be observed, it is possible to install a specially designed flow conditioner which can be ordered from Endress+Hauser. The flow conditioner is fitted between two pipe flanges and centered by the mounting bolts. Generally this reduces the inlet run needed to 10 × DN with full accuracy.

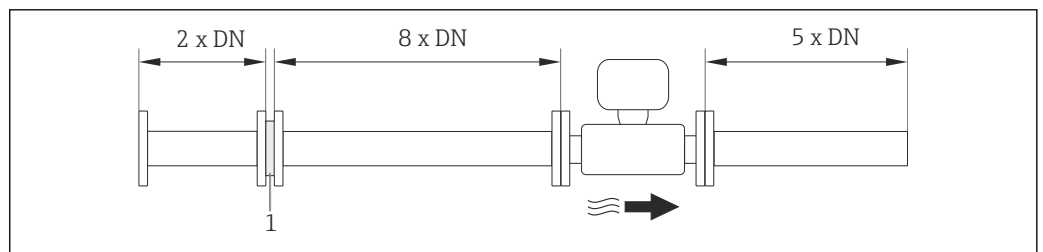

A0019208

1 Flow conditioner

The pressure loss for flow conditioners is calculated as follows:  $\Delta p \text{ [mbar]} = 0.0085 \cdot \rho \text{ [kg/m}^3] \cdot v^2 \text{ [m/s]}$

Example for steam

$p = 10 \text{ bar abs.}$

$t = 240 \text{ }^\circ\text{C} \rightarrow \rho = 4.39 \text{ kg/m}^3$

$v = 40 \text{ m/s}$

$\Delta p = 0.0085 \cdot 4.39 \cdot 40^2 = 59.7 \text{ mbar}$

Example for H<sub>2</sub>O condensate (80 °C)

$\rho = 965 \text{ kg/m}^3$


$v = 2.5 \text{ m/s}$

$\Delta p = 0.0085 \cdot 965 \cdot 2.5^2 = 51.3 \text{ mbar}$

$\rho$  : density of the process medium


$v$ : average flow velocity

abs. = absolute

 For information on the flow conditioner ( $\rightarrow$   60)

### Outlet runs when installing external devices

If installing an external device, observe the specified distance.

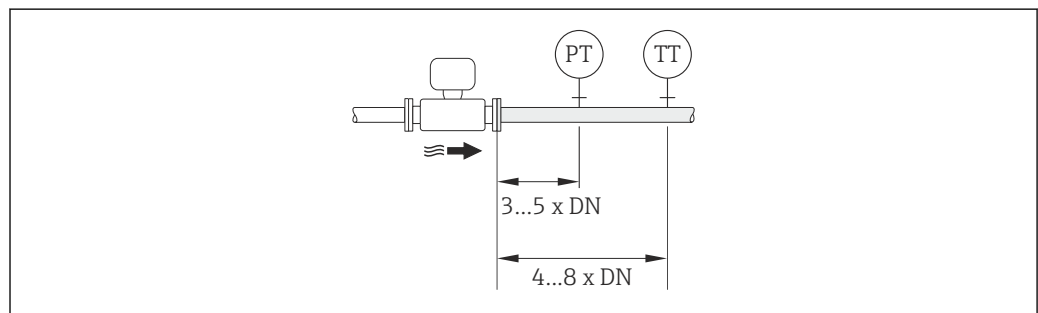

A0019205

PT Pressure transmitter

TT Temperature transmitter


### Mounting kit

#### Mounting kit for disc (wafer version)

The centering rings supplied are used to mount and center the wafer-style devices.

A mounting kit comprises:

- Tie rods
- Seals
- Nuts
- Washers

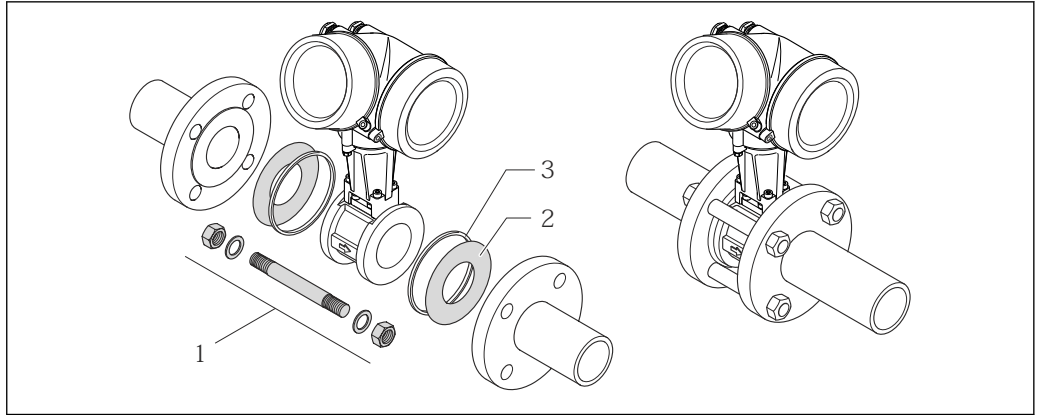

A0019875

12 Mounting kit for wafer version

- 1 Nut, washer, tie rod
- 2 Seal
- 3 Centering ring (is supplied with the measuring device)

**i** A mounting kit can be ordered separately (see the "Accessories" section (→ 77)).

**Length of connecting cable**


To ensure correct measuring results when using the remote version,

- observe the maximum permitted cable length  $L_{max}$ .
- The value for the cable length must be calculated if the cable cross-section differs from the specification.

**i** For detailed information about calculating the length of the connecting cable, refer to the Operating Instructions for the device on the CD-ROM provided

**Installing the wall-mount housing**


**Wall mounting**

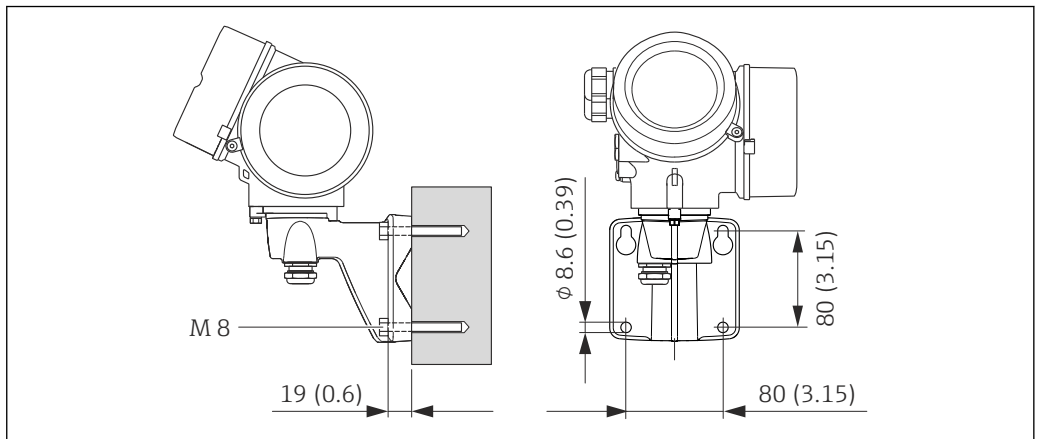

A0019864

13 Engineering unit mm (in)

## Shaft mounting

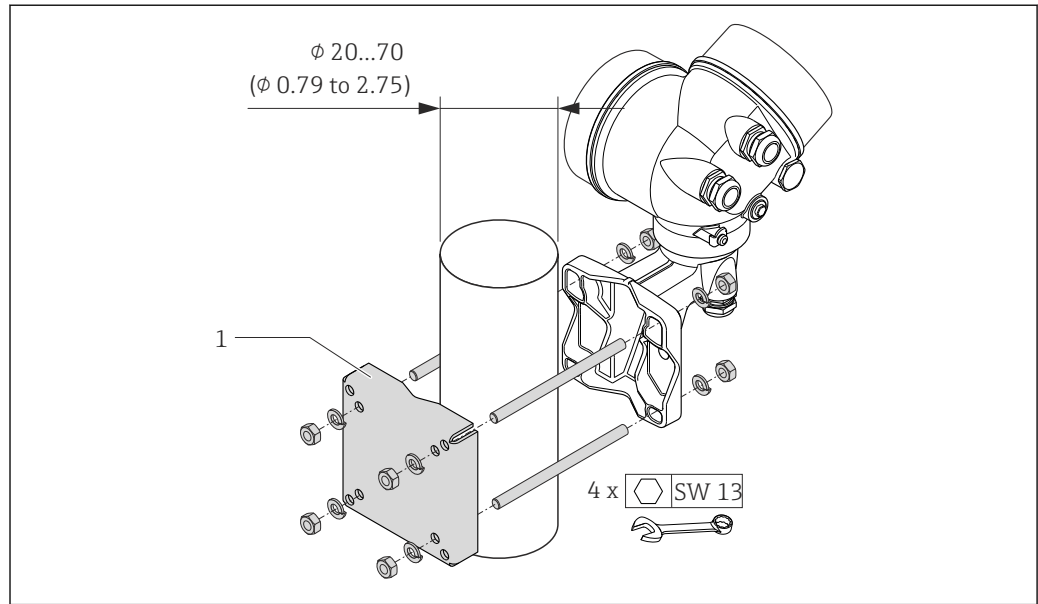

A0019862

14 Engineering unit mm (in)

1 Post mounting kit




**Special mounting instructions**

**Installation for delta heat measurements**

Order code for "Sensor version", option 3 "Mass flow (integrated temperature measurement)"

The second temperature measurement is taken using a separate temperature sensor. The measuring device reads in this value via a communication interface.

- In the case of saturated steam delta heat measurements, the Prowirl 200 must be installed on the steam side.
- In the case of water delta heat measurements, the Prowirl 200 can be installed on the cold or warm side.

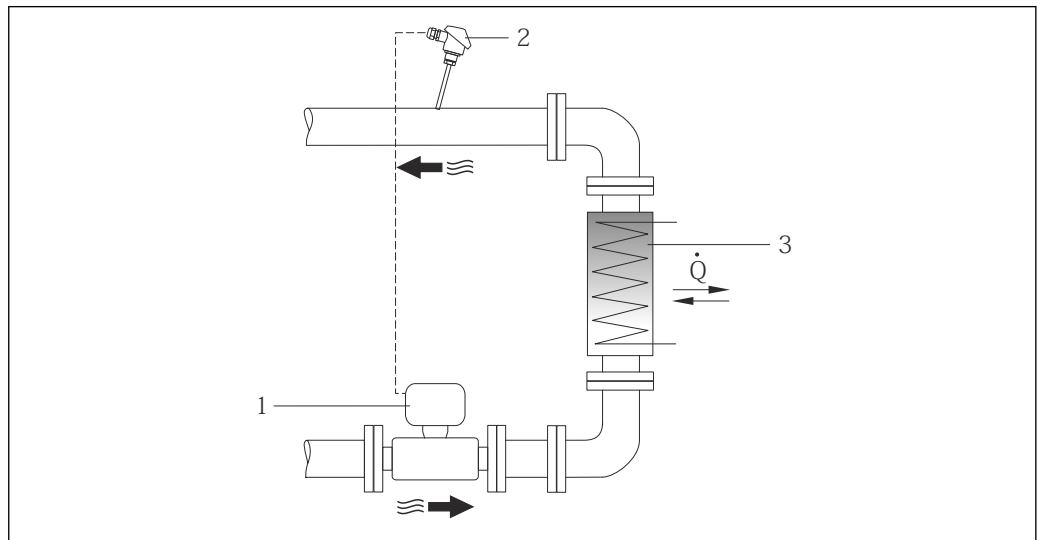



15 Layout for delta heat measurement of saturated steam and water

- 1 Prowirl
- 2 Temperature sensor
- 3 Heat exchanger
- Q Heat flow

**Weather protection cover**

Observe the following minimum head clearance: 222 mm (8.74 in)

 For information the weather protection cover, see (→  76)

**Environment**

**Ambient temperature range**

Compact version

<b>Measuring device</b>	Non-Ex:	-40 to +80 °C (-40 to +176 °F) <sup>1)</sup>
	Ex i:	-40 to +70 °C (-40 to +158 °F) <sup>1)</sup>
	EEx d/XP version:	-40 to +60 °C (-40 to +140 °F) <sup>1)</sup>
	ATEX II1/2G Ex d, Ex ia:	-40 to +60 °C (-40 to +140 °F) <sup>1)</sup>
<b>Local display</b>		-20 to +60 °C (-4 to +140 °F)

1) Additionally available as order code for "Test, certificate", option JN "Transmitter ambient temperature -50 °C (-58 °F)".

*Remote version*

<b>Transmitter</b>	Non-Ex:	-40 to +80 °C (-40 to +176 °F) <sup>1)</sup>
	Ex i:	-40 to +80 °C (-40 to +176 °F) <sup>1)</sup>
	Ex d:	-40 to +60 °C (-40 to +140 °F) <sup>1)</sup>
	ATEX II1/2G Ex d, Ex ia:	-40 to +60 °C (-40 to +140 °F) <sup>1)</sup>
<b>Sensor</b>	Non-Ex:	-40 to +85 °C (-40 to +185 °F) <sup>1)</sup>
	Ex i:	-40 to +85 °C (-40 to +185 °F) <sup>1)</sup>
	Ex d:	-40 to +85 °C (-40 to +185 °F) <sup>1)</sup>
	ATEX II1/2G Ex d, Ex ia:	-40 to +85 °C (-40 to +185 °F) <sup>1)</sup>
<b>Local display</b>		-20 to +60 °C (-4 to +140 °F)

- 1) Additionally available as order code for "Test, certificate", option JN "Transmitter ambient temperature -50 °C (-58 °F)".

- If operating outdoors:  
Avoid direct sunlight, particularly in warm climatic regions.

 Weather protection covers can be ordered from Endress+Hauser: see "Accessories" section (→  76)

**Temperature tables**

$T_m$  = fluid temperature,  $T_a$  = ambient temperature

The following interdependencies between the permitted ambient and fluid temperatures apply when operating the device in hazardous areas:

*Compact version*

Order code for "Sensor version", option 1 "Volume flow, basis", option 3 "Mass flow (integrated temperature measurement)"

Order code for "Sensor version", option 2 "Volume flow, high-temperature/low-temperature"

 The following temperature tables apply for the low-temperature version (→  42).

**Order code for "Output", option A "4-20mA HART"**

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- $cCSA_{US}$  IS,  $cCSA_{US}$  XP,  $cCSA_{US}$  NI

*SI units*

Version with max. $T_m = 280$ °C						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	280	-
60	-	95	130	195	280	-
65	-	-	130	195	280	-
70	-	-	130	-	-	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2$  °C

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a^{1)}$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	536	–
140	–	203	266	383	536	–
149	–	–	266	383	536	–
158	–	–	266	–	–	–

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$

**Order code for "Output", option B "4-20mA HART, pulse/frequency/switch output"**

Order code for "Approval", options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2

- Ex ia, Ex ic, Ex tb
- cCSA<sub>US</sub> IS

SI units

Version with max. $T_m = 280\text{ °C}$						
$T_a^{1)}$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35 <sup>2)</sup>	80	95	130	195	280	–
50 <sup>3)</sup>	–	95	130	195	280	–
60	–	–	130	195	280	–
65	–	–	130	195	280 <sup>4)</sup>	–
70	–	–	130	195 <sup>5)</sup>	280 <sup>5)</sup>	–

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2\text{ °C}$
- 2)  $T_a = 40\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 55\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 65\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$
- 5)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a^{1)}$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
95 <sup>2)</sup>	176	203	266	383	536	–
122 <sup>3)</sup>	–	203	266	383	536	–
140	–	–	266	383	536	–
149	–	–	266	383	536 <sup>4)</sup>	–
158	–	–	266	383 <sup>5)</sup>	536 <sup>5)</sup>	–

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$
- 2)  $T_a = 104\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 131\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 149\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$
- 5)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$

Order code for "Approval", options BC, BG, BK, B3, IC, IG, IK, I5, C3

- Ex d, Ex nA, Ex tb
- cCSA<sub>US</sub> XP

SI units

Version with max. $T_m = 280\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	280	-
55	-	95	130	195	280	-
65	-	-	130	195	280 <sup>1)</sup>	-
70	-	-	130	195 <sup>2)</sup>	280 <sup>2)</sup>	-

- 1)  $T_a = 65\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$
- 2)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	536	-
131	-	203	266	383	536	-
149	-	-	266	383	536 <sup>1)</sup>	-
158	-	-	266	383 <sup>2)</sup>	536 <sup>2)</sup>	-

- 1)  $T_a = 149\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$
- 2)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.7\text{ W}$

#### Order code for "Output", option C "4-20mA HART, 4-20mA"

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. $T_m = 280\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	280	-
55	-	95	130	195	280	-
60	-	-	130	195	280	-
65	-	-	130	195	280 <sup>2)</sup>	-
70	-	-	130	-	-	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, JJ, I4, C2:  $T_a = T_m - 2\text{ °C}$
- 2)  $T_a = 65\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	536	-
131	-	203	266	383	536	-
140	-	-	266	383	536	-
149	-	-	266	383	536 <sup>2)</sup>	-
158	-	-	266	-	-	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_a - 35.6\text{ °F}$
- 2)  $T_a = 149\text{ °F}$  for pulse/frequency/switch output  $P_1 = 0\text{ W}$

**Order code for "Output", option D "4-20 mA HART, PFS output; 4-20 mA input"**

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. $T_m = 280\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35	80	95	130	195	280	-
50	-	95	130	195	280	-
55	-	-	-	195	280	-
60	-	-	-	195	-	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_a - 2\text{ °C}$

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
95	176	203	266	383	536	-
122	-	203	266	383	536	-
131	-	-	-	383	536	-
140	-	-	-	383	-	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_a - 35.6\text{ °F}$

**Order code for "Output", option G "PROFIBUS PA, pulse/frequency/switch output"**

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. $T_m = 280\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	280	-
50 <sup>2)</sup>	-	95	130	195	280	-
60	-	-	130	195	280	-
65	-	-	130	195	280 <sup>3)</sup>	-
70	-	-	130	195 <sup>4)</sup>	280 <sup>4)</sup>	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2\text{ °C}$
- 2)  $T_a = 60\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 3)  $T_a = 65\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 4)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

US units

Version with max. $T_m = 536\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	536	-
122 <sup>2)</sup>	-	203	266	383	536	-
140	-	-	266	383	536	-
149	-	-	266	383	536 <sup>3)</sup>	-
158	-	-	266	383 <sup>4)</sup>	536 <sup>4)</sup>	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$
- 2)  $T_a = 140\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 3)  $T_a = 149\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 4)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

High-temperature version

Order code for "Sensor version", option 2 "Volume flow, high-temperature/low-temperature"



The following temperature tables apply for the high-temperature version (→ 47).

Order code for "Output", option A "4-20mA HART"

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. T <sub>m</sub> = 440 °C						
T <sub>a</sub> <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	290	440
60	-	95	130	195	290	440
70	-	-	130	195	290	440

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2: T<sub>a</sub> = T<sub>a</sub> - 2 °C

US units

Version with max. T <sub>m</sub> = 824 °F						
T <sub>a</sub> <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	554	824
140	-	203	266	383	554	824
158	-	-	266	383	554	824

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2: T<sub>a</sub> = T<sub>a</sub> - 35.6 °F

**Order code for "Output", option B "4-20mA HART, pulse/frequency/switch output"**

Order code for "Approval", options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2

- Ex ia, Ex ic, Ex tb
- cCSA<sub>US</sub> IS

SI units

Version with max. T <sub>m</sub> = 440 °C						
T <sub>a</sub> <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35 <sup>2)</sup>	80	95	130	195	290	440
50 <sup>3)</sup>	-	95	130	195	290	440
65	-	-	130	195	290	440
70	-	-	130	195 <sup>4)</sup>	290	440 <sup>4)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2: T<sub>a</sub> = T<sub>a</sub> - 2 °C
- 2) T<sub>a</sub> = 40 °C for pulse/frequency/switch output P<sub>1</sub> = 0.85 W
- 3) T<sub>a</sub> = 55 °C for pulse/frequency/switch output P<sub>1</sub> = 0.85 W
- 4) T<sub>a</sub> = 70 °C for pulse/frequency/switch output P<sub>1</sub> = 0.85 W

US units

Version with max. T <sub>m</sub> = 824 °F						
T <sub>a</sub> <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
95 <sup>2)</sup>	176	203	266	383	554	824
122 <sup>3)</sup>	-	203	266	383	554	824

Version with max. $T_m = 824\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
149	-	-	266	383	554	824
158	-	-	266	383 <sup>4)</sup>	554	824 <sup>4)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$
- 2)  $T_a = 104\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 131\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$

Order code for "Approval", options BC, BG, BK, B3, IC, IG, IK, I5, C3

- Ex d, Ex nA, Ex tb
- cCSA<sub>US</sub> XP

SI units

Version with max. $T_m = 440\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	290	440
55	-	95	130	195	290	440
65	-	-	130	195	290	440
70	-	-	130	195 <sup>1)</sup>	290 <sup>1)</sup>	440 <sup>1)</sup>

- 1)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$

US units

Version with max. $T_m = 824\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	554	824
131	-	203	266	383	554	824
149	-	-	266	383	554	824
158	-	-	266	383 <sup>1)</sup>	554 <sup>1)</sup>	824 <sup>1)</sup>

- 1)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$

Order code for "Output", option C "4-20mA HART, 4-20mA"

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. $T_m = 440\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	290	440
55	-	95	130	195	290	440



Version with max. $T_m = 440\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
65	-	-	130	195	290	440
70	-	-	130	195 <sup>2)</sup>	290 <sup>2)</sup>	440 <sup>2)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2\text{ °C}$
- 2)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

US units

Version with max. $T_m = 824\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	554	824
131	-	203	266	383	554	824
149	-	-	266	383	554	824
158	-	-	266	383 <sup>2)</sup>	554 <sup>2)</sup>	824 <sup>2)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$
- 2)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

**Order code for "Output", option D "4-20 mA HART, PFS output; 4-20 mA input"**

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- $cCSA_{US}$  IS,  $cCSA_{US}$  XP,  $cCSA_{US}$  NI

SI units

Version with max. $T_m = 440\text{ °C}$						
$T_a$ <sup>1)</sup> [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
35	80	95	130	195	290	440
50	-	95	130	195	290	440
55	-	-	-	195	290	440
60	-	-	-	195	290	440
65	-	-	-	-	290	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2\text{ °C}$

US units

Version with max. $T_m = 824\text{ °F}$						
$T_a$ <sup>1)</sup> [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
95	176	203	266	383	554	824
122	-	203	266	383	554	824
131	-	-	-	383	554	824

Version with max. $T_m = 824\text{ °F}$						
$T_a^{1)}$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
140	-	-	-	383	554	824
149	-	-	-	-	554	-

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$

#### Order code for "Output", option G "PROFIBUS PA, pulse/frequency/switch output"

Order code for "Approval", all options

- Ex d, Ex ia, Ex ic, Ex nA, Ex tb
- cCSA<sub>US</sub> IS, cCSA<sub>US</sub> XP, cCSA<sub>US</sub> NI

SI units

Version with max. $T_m = 440\text{ °C}$						
$T_a^{1)}$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
40	80	95	130	195	290	440
50 <sup>2)</sup>	-	95	130	195	290	440
65	-	-	130	195	290	440
70	-	-	130	195 <sup>3)</sup>	290 <sup>3)</sup>	440 <sup>3)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 2\text{ °C}$
- 2)  $T_a = 60\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 3)  $T_a = 70\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

US units

Version with max. $T_m = 824\text{ °F}$						
$T_a^{1)}$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	554	824
122 <sup>2)</sup>	-	203	266	383	554	824
149	-	-	266	383	554	824
158	-	-	266	383 <sup>3)</sup>	554 <sup>3)</sup>	824 <sup>3)</sup>

- 1) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_m - 35.6\text{ °F}$
- 2)  $T_a = 140\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 3)  $T_a = 158\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$

Remote version

Transmitter

Order code for "Housing", option J "GT20 two-chamber, remote G314, aluminum coated"; option K "GT20 two-chamber, remote G315, 316L"

SI units

Order code for "Output", option	Order code for "Approval", option	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]
A	All	40	60	75
B	BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2	35 <sup>1)</sup>	50 <sup>2)</sup>	70 <sup>3)</sup>
	BC, BG, BK, B3, IC, IG, IK, I5, C3	40	55	70 <sup>3)</sup>
C	All	40	55	70 <sup>4)</sup>
D	All	35 <sup>5)</sup>	50 <sup>5)</sup>	65
G	All	40	55	70 <sup>4)</sup>

- 1)  $T_a = 40\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 2)  $T_a = 60\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 75\text{ °C}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 75\text{ °C}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 5) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_a - 2\text{ °C}$

US units



Order code for "Output", option	Order code for "Approval", option	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]
A	All	104	140	167
B	BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2	95 <sup>1)</sup>	122 <sup>2)</sup>	158 <sup>3)</sup>
	BC, BG, BK, B3, IC, IG, IK, I5, C3	104	131	158 <sup>3)</sup>
C	All	104	131	158 <sup>4)</sup>
D	All	95 <sup>5)</sup>	122 <sup>5)</sup>	149
G	All	104	131	158 <sup>4)</sup>

- 1)  $T_a = 104\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 2)  $T_a = 140\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 3)  $T_a = 167\text{ °F}$  for pulse/frequency/switch output  $P_i = 0.85\text{ W}$
- 4)  $T_a = 167\text{ °F}$  for pulse/frequency/switch output  $P_i = 0\text{ W}$
- 5) The following applies for installations with overvoltage protection in conjunction with temperature class T5, T6 and approval options BA, BB, BD, BH, BJ, B2, IA, IB, ID, IH, IJ, I4, C2:  $T_a = T_a - 35.6\text{ °F}$

Sensor

Order code for "Sensor version", option 1 "Volume flow, basis"; option 3 "Mass flow (integrated temperature measurement)"

Order code for "Sensor version", option 2 "Volume flow, high-temperature/low-temperature"

 The following temperature tables apply for the low-temperature version (→  52).

*SI units*



Version with max. $T_m = 280\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
55	80	95	130	195	280	–
70	–	95	130	195	280	–
85	–	–	130	195	280	–

*US units*

Version with max. $T_m = 536\text{ °F}$						
$T_a$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
104	176	203	266	383	536	–
122	–	203	266	383	536	–
149	–	–	266	383	536	–

*High-temperature version*

Order code for "Sensor version", option 2 "Volume flow, high-temperature/low-temperature"

 The following temperature tables apply for the high-temperature version (→  52).

*SI units*

Version with max. $T_m = 440\text{ °C}$						
$T_a$ [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
55	80	95	130	195	290	440
70	–	95	130	195	290	440
85	–	–	130	195	290	440

*US units*

Version with max. $T_m = 824\text{ °F}$						
$T_a$ [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
131	176	203	266	383	554	824
158	–	203	266	383	554	824
185	–	–	266	383	554	824


**Storage temperature**

All components apart from the display modules:  
–50 to +80 °C (–58 to +176 °F)

Display modules:  
–40 to +80 °C (–40 to +176 °F)

**Climate class**

DIN EN 60068-2-38 (test Z/AD)


<b>Degree of protection</b>	<p><b>Transmitter</b></p> <ul style="list-style-type: none"> <li>■ As standard: IP66/67, type 4X enclosure</li> <li>■ When housing is open: IP20, type 1 enclosure</li> <li>■ Display module: IP20, type 1 enclosure</li> </ul> <p><b>Sensor</b> IP66/67, type 4X enclosure</p> <p><b>Connector</b> IP67, only in screwed situation</p>
<b>Vibration resistance</b>	<ul style="list-style-type: none"> <li>■ For compact/remote version made of coated aluminum and remote version made of stainless steel: Acceleration up to 2g (if gain set to factory setting), 10 to 500 Hz, following IEC 60068-2-6</li> <li>■ For the compact version made of stainless steel: Acceleration up to 1g (if gain set to factory setting), 10 to 500 Hz, following IEC 60068-2-6</li> </ul>
<b>Electromagnetic compatibility (EMC)</b>	<p>As per IEC/EN 61326 and NAMUR Recommendation 21 (NE 21)</p> <p> For details refer to the Declaration of Conformity.</p>

## Process

<b>Medium temperature range</b>	<p><b>DSC sensor<sup>3)</sup></b> Order code for "Sensor version":</p> <ul style="list-style-type: none"> <li>■ Option 1 "Volume flow, basis": -40 to +260 °C (-40 to +500 °F), stainless steel</li> <li>■ Option 2 "Volume flow, high-temperature/low temperature": -200 to +400 °C (-328 to +752 °F), stainless steel</li> <li>■ Option 3 "Mass flow (integrated temperature measurement)": -200 to +400 °C (-328 to +752 °F), stainless steel</li> </ul> <p><b>DSC sensor<sup>3)</sup></b> Order code for "Sensor option": Option CD "Harsh environment, DSC sensor components, Alloy C22": -200 to +400 °C (-328 to +752 °F), DSC sensor Alloy C22</p> <p><b>DSC sensor<sup>3)</sup></b> <i>Special version for very high fluid temperatures (on request):</i></p> <ul style="list-style-type: none"> <li>■ -200 to +450 °C (-328 to +842 °F)</li> <li>■ -200 to +440 °C (-328 to +824 °F), Ex version</li> <li>■</li> </ul> <p><b>Seals</b></p> <ul style="list-style-type: none"> <li>■ -200 to +400 °C (-328 to +752 °F) for graphite (standard)</li> <li>■ -15 to +175 °C (+5 to +347 °F) for Viton</li> <li>■ -20 to +275 °C (-4 to +527 °F) for Kalrez</li> <li>■ -200 to +260 °C (-328 to +500 °F) for Gylon</li> </ul>
<b>Pressure-temperature ratings</b>	<p>The following pressure-temperature ratings refer to the entire device and not just the process connection.</p> <p>The pressure-temperature rating for the specific measuring device is programmed into the software. If values exceed the curve range a warning is displayed. Depending on the system configuration and sensor version, the pressure and temperature are determined by entering, reading in or calculating values.</p>

3) Capacitance sensor


**Process connection: wafer flange to EN 1092-1 (DIN 2501)**

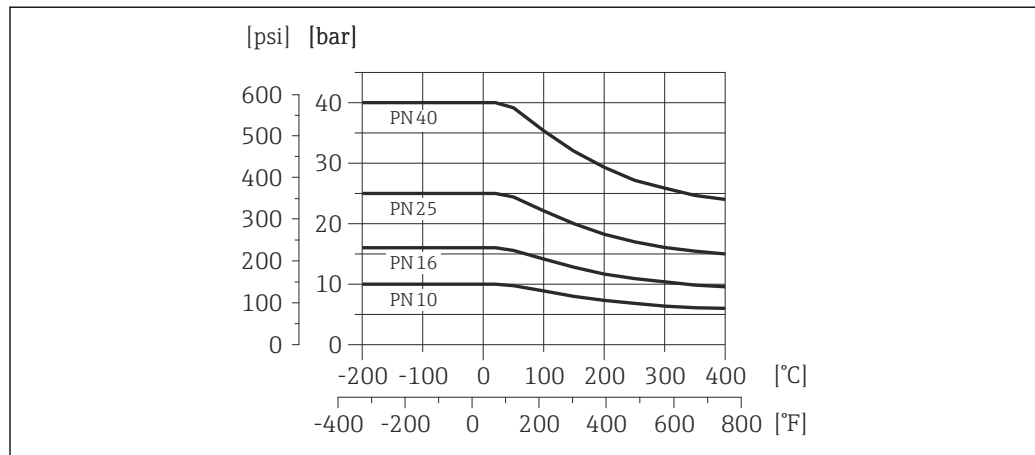

A0020879-EN

16 Process connection material: stainless cast steel, multiple certifications, 1.4408 (CF3M)


**Process connection: wafer flange to ASME B16.5**

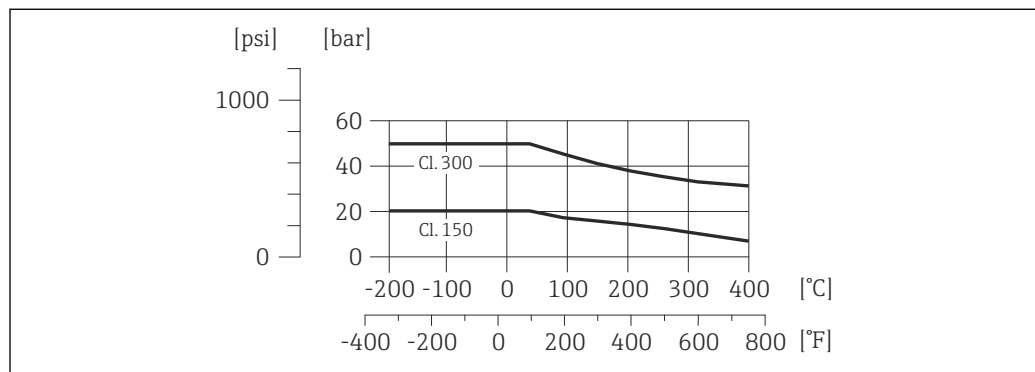

A0020880-EN

17 Process connection material: stainless cast steel, multiple certifications, 1.4408 (CF3M)

**Process connection: wafer flange to JIS B2220**

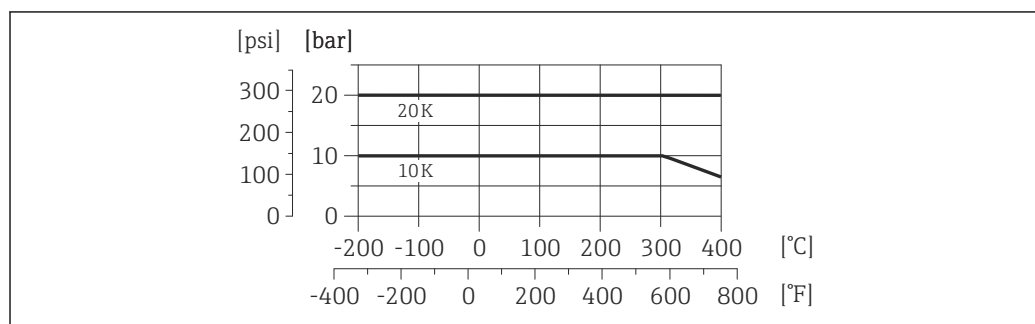

A0020881-EN

18 Process connection material: stainless cast steel, multiple certifications, 1.4408 (CF3M)

**Pressure loss**


For a precise calculation, use the Applicator(→ 78).

**Thermal insulation**

For optimum temperature measurement and mass calculation, heat transfer at the sensor must be avoided for some fluids. This can be ensured by installing thermal insulation. A wide range of materials can be used for the required insulation.

- This applies for:
- Compact version
  - Remote sensor version

The maximum insulation height permitted is illustrated in the diagram:

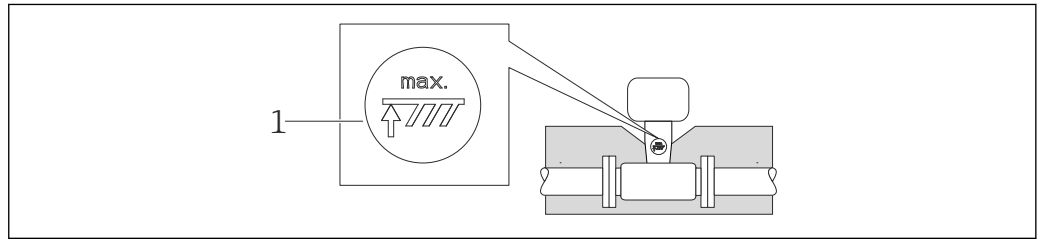

A0019212

1 Maximum insulation height

► When insulating, ensure that a sufficiently large area of the housing support remains exposed. The uncovered part serves as a radiator and protects the electronics from overheating and excessive cooling.

**Vibrations**


The correct operation of the measuring system is not affected by plant vibrations up to 1 g, 10 to 500 Hz. Therefore no special measures are needed to secure the sensors.

## Mechanical construction

**Design, dimensions**

**Compact version**

Order code for "Housing", option B "GT18, two-chamber, 316L"; option C "GT20, two-chamber, aluminum coated"

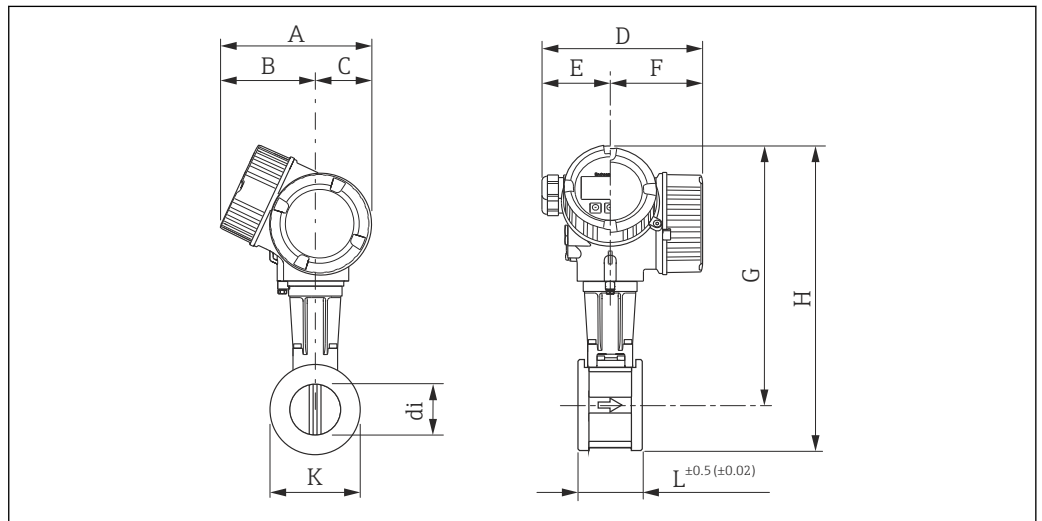

A0020271

19 Engineering unit mm (in)

*Dimensions in SI units*

DN	A	B <sup>1)</sup>	C	D <sup>2)</sup>	E	F <sup>2)</sup>	G <sup>3) 4)</sup>	H <sup>3) 4)</sup>	L	K	di
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
15	162	102	60	165	75	90	252.5	275.9	65	5)	5)
25	162	102	60	165	75	90	262.0	294.4	65	5)	5)

DN	A	B <sup>1)</sup>	C	D <sup>2)</sup>	E	F <sup>2)</sup>	G <sup>3) 4)</sup>	H <sup>3) 4)</sup>	L	K	di
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
40	162	102	60	165	75	90	270.5	312.0	65	<sup>5)</sup>	<sup>5)</sup>
50	162	102	60	165	75	90	277.5	324.0	65	<sup>5)</sup>	<sup>5)</sup>
80	162	102	60	165	75	90	291.5	355.5	65	<sup>5)</sup>	<sup>5)</sup>
100 <sup>6)</sup>	162	102	60	165	75	90	304.0	383.1	65	<sup>5)</sup>	<sup>5)</sup>
100 <sup>7)</sup>	162	102	60	165	75	90	303.2	382.3	65	<sup>5)</sup>	<sup>5)</sup>
150	162	102	60	165	75	90	330.0	438.5	65	<sup>5)</sup>	<sup>5)</sup>

- 1) For version without local display: values - 7 mm
- 2) For version with overvoltage protection: values + 8 mm
- 3) For version without local display: values - 10 mm
- 4) For high-temperature/low-temperature version: values + 29 mm
- 5) Depends on the particular wafer version
- 6) EN (DIN), ASME
- 7) JIS

*Dimensions in US units*


DN	A	B <sup>1)</sup>	C	D <sup>2)</sup>	E	F <sup>2)</sup>	G <sup>3) 4)</sup>	H <sup>3) 4)</sup>	L	K	di
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
½	6.38	4.02	2.36	6.50	2.95	3.54	9.94	10.86	2.56	<sup>5)</sup>	<sup>5)</sup>
1	6.38	4.02	2.36	6.50	2.95	3.54	10.31	11.59	2.56	<sup>5)</sup>	<sup>5)</sup>
1 ½	6.38	4.02	2.36	6.50	2.95	3.54	10.65	12.28	2.56	<sup>5)</sup>	<sup>5)</sup>
2	6.38	4.02	2.36	6.50	2.95	3.54	10.93	12.76	2.56	<sup>5)</sup>	<sup>5)</sup>
3	6.38	4.02	2.36	6.50	2.95	3.54	11.48	14.00	2.56	<sup>5)</sup>	<sup>5)</sup>
4 <sup>6)</sup>	6.38	4.02	2.36	6.50	2.95	3.54	11.97	15.08	2.56	<sup>5)</sup>	<sup>5)</sup>
4 <sup>7)</sup>	6.38	4.02	2.36	6.50	2.95	3.54	11.94	15.05	2.56	<sup>5)</sup>	<sup>5)</sup>
6	6.38	4.02	2.36	6.50	2.95	3.54	12.99	17.26	2.56	<sup>5)</sup>	<sup>5)</sup>

- 1) For version without local display: values - 0.28 in
- 2) For version with overvoltage protection: values + 0.31 in
- 3) For version without local display: values - 0.39 in
- 4) For high-temperature/low-temperature version: values + 1.14 in
- 5) Depends on the particular wafer version
- 6) EN (DIN), ASME
- 7) JIS



**Transmitter remote version**

Order code for "Housing", option J "GT20, remote, aluminum coated"; option K "GT18 remote, 316L"

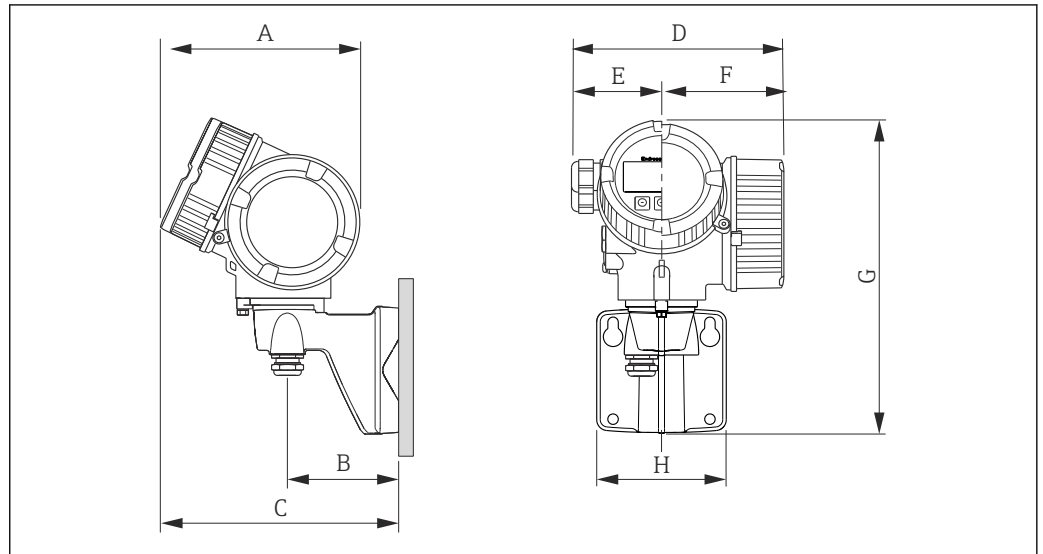

A0020089

*Dimensions in SI units*

A <sup>1)</sup> [mm]	B [mm]	C <sup>1)</sup> [mm]	D <sup>2)</sup> [mm]	E [mm]	F <sup>2)</sup> [mm]	G <sup>3)</sup> [mm]	H [mm]
162	90	191	165	75	90	254	107

- 1) For device version without local display: value - 7 mm
- 2) For device version with overvoltage protection (OVP): value + 8 mm
- 3) For device version without local operation: value - 10 mm


*Dimensions in US units*

A <sup>1)</sup> [in]	B [in]	C [in]	D <sup>2)</sup> [in]	E [in]	F [in]	G <sup>3)</sup> [in]	H [in]
6,38	3,54	7,52	6,5	2,75	3,54	10,0	4,21

- 1) For device version without local display: value - 0.28 in
- 2) For device version with overvoltage protection (OVP): value + 0.31 in
- 3) For device version without local operation: value - 0.39 in

**Sensor remote version**

Order code for "Housing", option J "GT20, remote, aluminum coated"; option K "GT18, remote, 316L"

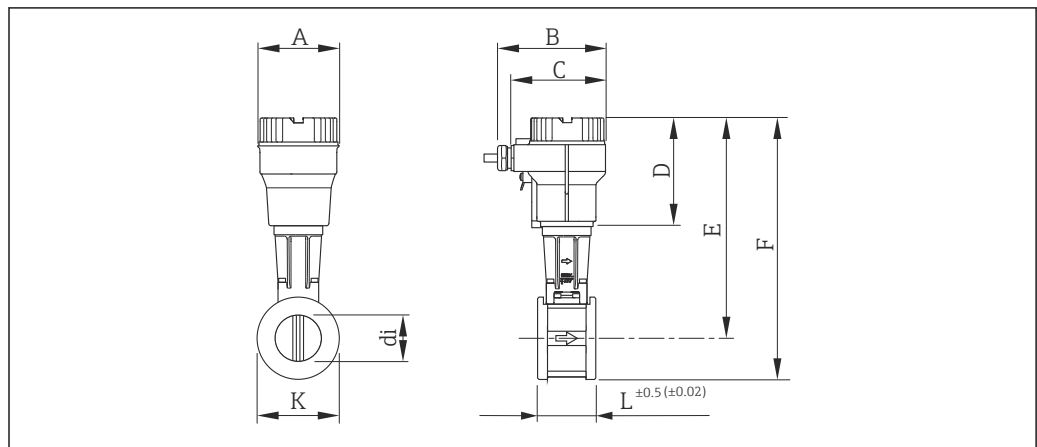

A0020264

20 Engineering unit mm (in)

*Dimensions in SI units*

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E <sup>1)</sup> [mm]	F <sup>1)</sup> [mm]	L [mm]	K [mm]	di [mm]
15	94.3	134.3	107.3	115.8	222.8	246.2	65	2)	2)
25	94.3	134.3	107.3	115.8	232.3	264.7	65	2)	2)
40	94.3	134.3	107.3	115.8	240.8	282.3	65	2)	2)
50	94.3	134.3	107.3	115.8	247.8	294.3	65	2)	2)
80	94.3	134.3	107.3	115.8	261.8	325.8	65	2)	2)
100 <sup>3)</sup>	94.3	134.3	107.3	115.8	274.3	353.4	65	2)	2)
100 <sup>4)</sup>	94.3	134.3	107.3	115.8	273.5	352.6	65	2)	2)
150	94.3	134.3	107.3	115.8	300.3	408.8	65	2)	2)

- 1) For high-temperature/low-temperature version: values + 29 mm
- 2) Depends on the particular wafer version
- 3) EN (DIN), ASME
- 4) JIS

*Dimensions in US units*

DN [in]	A [in]	B [in]	C [in]	D [in]	E <sup>1)</sup> [in]	F <sup>1)</sup> [in]	L [in]	K [in]	di [in]
½	3.71	5.29	4.22	4.56	8.77	9.69	2.56	2)	2)
1	3.71	5.29	4.22	4.56	9.15	10.42	2.56	2)	2)
1 ½	3.71	5.29	4.22	4.56	9.48	11.11	2.56	2)	2)
2	3.71	5.29	4.22	4.56	9.76	11.59	2.56	2)	2)
3	3.71	5.29	4.22	4.56	10.31	12.83	2.56	2)	2)
4 <sup>3)</sup>	3.71	5.29	4.22	4.56	10.8	13.91	2.56	2)	2)

DN [in]	A [in]	B [in]	C [in]	D [in]	E <sup>1)</sup> [in]	F <sup>1)</sup> [in]	L [in]	K [in]	di [in]
4 <sup>4)</sup>	3.71	5.29	4.22	4.56	10.77	13.88	2.56	2)	2)
6	3.71	5.29	4.22	4.56	11.82	16.09	2.56	2)	2)

- 1) For high-temperature/low-temperature version: values + 1.14 in
- 2) Depends on the particular wafer version
- 3) EN (DIN), ASME
- 4) JIS

**Process connections in SI units**

*Wafer flange EN (DIN)*

Wafer version as per EN 1092-1 (DIN 2501), PN 10 to 40		
DN [mm]	K [mm]	di [mm]
15	45.0	16.5
25	64.0	27.6
40	82.0	42.0
50	92.0	53.5
80	127.0	80.3
100	157.2	104.8
150	215.9	156.8

*Wafer flange ASME B16.5*

Wafer version as per ASME B16.5, Cl. 150 to 300: Sch. 40/80			
DN [mm]	K [mm]	Sch. 40 di [mm]	Sch. 80 di [mm]
15	45.0	16.5	13.9
25	64.0	27.6	24.3
40	82.0	42.0	38.1
50	92.0	53.5	49.3
80	127.0	80.3	73.7
100	157.2	104.8	97.2
150	215.9	156.8	146.3

*Wafer flange JIS*

JIS B2220, 10 to 20K: Sch. 40/80			
DN [mm]	K [mm]	Sch. 40 di [mm]	Sch. 80 di [mm]
15 <sup>1)</sup>	45.0	16.5	13.9
25 <sup>1)</sup>	64.0	27.6	24.3
40 <sup>1)</sup>	82.0	42.0	38.1

JIS B2220, 10 to 20K: Sch. 40/80			
DN [mm]	K [mm]	Sch. 40 di [mm]	Sch. 80 di [mm]
50	92.0	53.5	49.3
80	127.0	80.3	73.7
100	157.2	102.3	97.2
150	215.9	156.8	146.3

1) Not available for JIS B2220, 10K

### Process connections in US units

Wafer flange ASME B16.5


Wafer version as per ASME B16.5, Cl. 150 to 300: Sch. 40/80			
DN [in]	K [in]	Sch. 40 di [in]	Sch. 80 di [in]
½	1.77	0.65	0.55
1	2.52	1.09	0.96
1 ½	3.23	1.65	1.50
2	3.62	2.11	1.94
3	5.00	3.16	2.90
4	6.19	4.13	3.83
6	8.51	6.18	5.76

### Accessories

Flow conditioner

Order code for "Accessory enclosed", option PF "Flow conditioner"

(according to EN 1092-1 (DIN 2501))

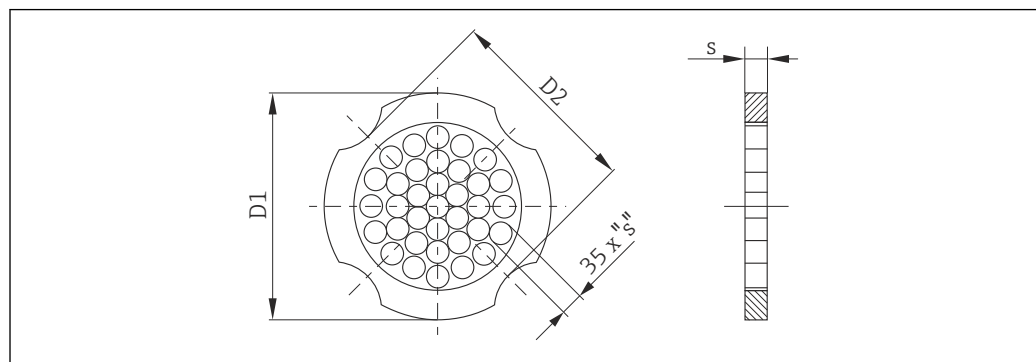

A0001941

Dimensions in SI units

DN [mm]	Pressure rating	Centering diameter [mm]	D1 <sup>1)</sup> / D2 <sup>2)</sup>	s [mm]
15	PN 10 to 40	54.3	D2	2.0
25	PN 10 to 40	74.3	D1	3.5
40	PN 10 to 40	95.3	D1	5.3
50	PN 10 to 40	110.0	D2	6.8
80	PN 10 to 40	145.3	D2	10.1
100	PN 10/16 PN 25/40	165.3 171.3	D2 D1	13.3
150	PN 10/16 PN 25/40	221.0 227.0	D2 D2	20.0

- 1) The flow conditioner is fitted at the outer diameter between the bolts.  
 2) The flow conditioner is fitted at the indentations between the bolts.

DN [mm]	Pressure rating	Centering diameter [mm]	D1 <sup>1)</sup> / D2 <sup>2)</sup>	s [mm]
15	Class 150 Class 300	50.1 56.5	D1 D1	2.0
25	Class 150 Class 300	69.2 74.3	D2 D1	3.5
40	Class 150 Class 300	88.2 97.7	D2 D2	5.3
50	Class 150 Class 300	106.6 113.0	D2 D1	6.8
80	Class 150 Class 300	138.4 151.3	D1 D1	10.1
100	Class 150 Class 300	176.5 182.6	D2 D1	13.3
150	Class 150 Class 300	223.5 252.0	D1 D1	20.0

- 1) The flow conditioner is fitted at the outer diameter between the bolts.  
 2) The flow conditioner is fitted at the indentations between the bolts.

DN [mm]	Pressure rating	Centering diameter [mm]	D1 <sup>1)</sup> / D2 <sup>2)</sup>	s [mm]
15	10 K 20 K	60.3 60.3	D2 D2	2.0
25	10 K 20 K	76.3 76.3	D2 D2	3.5
40	10 K 20 K	91.3 91.3	D2 D2	5.3
50	10 K 20 K	106.6 106.6	D2 D2	6.8
80	10 K 20 K	136.3 142.3	D2 D1	10.1

DN [mm]	Pressure rating	Centering diameter [mm]	D1 <sup>1)</sup> / D2 <sup>2)</sup>	s [mm]
100	10 K	161.3	D2	13.3
	20 K	167.3	D1	
150	10 K	221.0	D2	20.0
	20 K	240.0	D1	

- 1) The flow conditioner is fitted at the outer diameter between the bolts.  
 2) The flow conditioner is fitted at the indentations between the bolts.

#### Dimensions in US units

DN [in]	Pressure rating	Centering diameter [in]	D1 <sup>1)</sup> / D2 <sup>2)</sup>	s [in]
½	Class 150	1.97	D1	0.08
	Class 300	2.22	D1	
1	Class 150	2.72	D2	0.14
	Class 300	2.93	D1	
1½	Class 150	3.47	D2	0.21
	Class 300	3.85	D2	
2	Class 150	4.09	D2	0.27
	Class 300	4.45	D1	
3	Class 150	5.45	D1	0.40
	Class 300	5.96	D1	
4	Class 150	6.95	D2	0.52
	Class 300	7.19	D1	
6	Class 150	8.81	D1	0.79
	Class 300	9.92	D1	

- 1) The flow conditioner is fitted at the outer diameter between the bolts.  
 2) The flow conditioner is fitted at the indentations between the bolts.

## Weight

### Compact version

Weight data:

- Including the transmitter:
  - Order code for "Housing", option C: 1.8 kg (4.0 lbs)
  - Order code for "Housing", option B: 4.5 kg (9.9 lbs)
- Excluding packaging material

Weight in SI units

DN [mm]	Weight [kg]	
	Order code for "Housing", option C Alu coated <sup>1)</sup>	Order code for "Housing", option B 316L <sup>1)</sup>
15	3.1	5.8
25	3.3	6.0
40	3.9	6.6
50	4.2	6.9
80	5.6	8.3
100	6.6	9.3
150	9.1	11.8

- 1) For high-temperature/low-temperature version: values + 0.2 kg

*Weight in US units*

DN [in]	Weight [lbs]	
	Order code for "Housing", option C Alu coated <sup>1)</sup>	Order code for "Housing", option B 316L <sup>1)</sup>
½	6.9	12.9
1	7.4	13.3
1½	8.7	14.6
2	9.4	15.3
3	12.4	18.4
4	14.6	20.6
6	20.2	26.1

1) For high-temperature/low-temperature version: values +0.4 lbs

**Transmitter remote version**

*Wall-mount housing*

Depends on the material of the wall-mount housing:

- Aluminum AlSi 10Mg: 2.4 kg (5.2 lb)
- Stainless steel 1.4404 (316L): 6.0 kg (13.2 lb)

**Sensor remote version**

Weight data:

- Including the connection housing:
  - 0.8 kg (1.8 lbs)
  - 2.0 kg (4.4 lbs)
- Excluding the connecting cable
- Excluding packaging material

*Weight in SI units*

DN [mm]	Weight [kg]	
	Order code for "Housing", option C Alu coated <sup>1)</sup>	Order code for "Housing", option B 316L <sup>1)</sup>
15	2.1	3.3
25	2.3	3.5
40	2.9	4.1
50	3.2	4.4
80	4.6	5.8
100	5.6	6.8
150	8.1	9.3

1) For high-temperature/low-temperature version: values + 0.2 kg

*Weight in US units*

DN [in]	Weight [lbs]	
	Order code for "Housing", option C Alu coated <sup>1)</sup>	Order code for "Housing", option B 316L <sup>1)</sup>
½	4.5	7.3
1	5.0	7.8

DN [in]	Weight [lbs]	
	Order code for "Housing", option C Alu coated <sup>1)</sup>	Order code for "Housing", option B 316L <sup>1)</sup>
1½	6.3	9.1
2	7.0	9.7
3	10.0	12.8
4	12.3	15.0
6	17.3	20.5

1) For high-temperature/low-temperature version: values +0.4 lbs

### Accessories

#### Flow conditioner

#### Weight in SI units

DN <sup>1)</sup> [mm]	Pressure rating	Weight [kg]
15	PN10 to 40	0.04
25	PN10 to 40	0.1
40	PN10 to 40	0.3
50	PN10 to 40	0.5
80	PN10 to 40	1.4
100	PN10 to 40	2.4
150	PN 10/16 PN 25/40	6.3 7.8

1) EN (DIN)

DN <sup>1)</sup> [mm]	Pressure rating	Weight [kg]
15	Class 150 Class 300	0.03 0.04
25	Class 150 Class 300	0.1
40	Class 150 Class 300	0.3
50	Class 150 Class 300	0.5
80	Class 150 Class 300	1.2 1.4
100	Class 150 Class 300	2.7
150	Class 150 Class 300	6.3 7.8

1) ASME



DN <sup>1)</sup> [mm]	Pressure rating	Weight [kg]
15	10K 20K	0.06
25	10K 20K	0.1
40	10K 20K	0.3
50	10K 20K	0.5
80	10K 20K	1.1
100	10K 20K	1.8
150	10K 20K	4.5 5.5

1) JIS

*Weight in US units*

DN <sup>1)</sup> [in]	Pressure rating	Weight [lbs]
½	Class 150 Class 300	0.1 0.1
1	Class 150 Class 300	0.3
1½	Class 150 Class 300	0.7
2	Class 150 Class 300	1.1
3	Class 150 Class 300	2.6 3.1
4	Class 150 Class 300	6.0
6	Class 150 Class 300	14.0 16.0

1) ASME

**Materials**

**Transmitter housing**


**Compact version**

- Order code for "Housing", option **C** "Compact, aluminum coated":  
Coated aluminum AlSi10Mg
- Order code for "Housing", option **B** "Compact, stainless":  
For maximum corrosion resistance: stainless steel 1.4404 (316L)

**Remote version**

- Order code for "Housing", option **J** "Remote, aluminum coated":  
Coated aluminum AlSi10Mg
- Order code for "Housing", option **K** "Remote, stainless":  
For maximum corrosion resistance: stainless steel 1.4404 (316L)

### Cable entries/cable glands

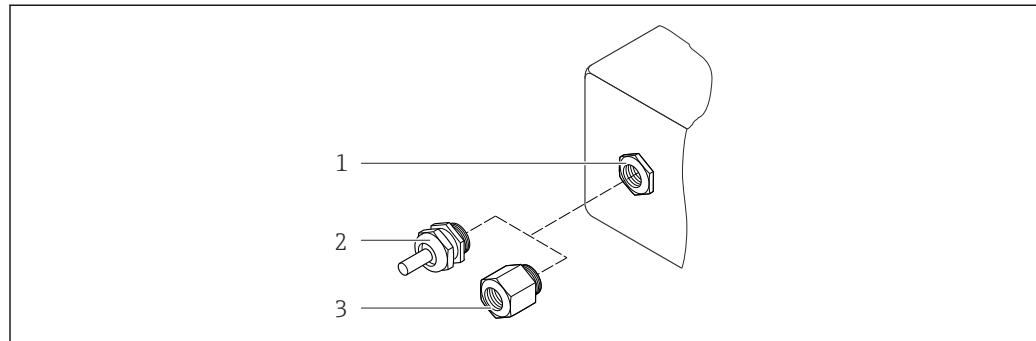

A0020640

#### 21 Possible cable entries/cable glands

- 1 Cable entry in transmitter housing, wall-mount housing or connection housing with internal thread M20 x 1.5
- 2 Cable gland M20 x 1.5
- 3 Adapter for cable entry with internal thread G 1/2" or NPT 1/2"

Order code for "Housing", option B "Compact, stainless", option K "Remote, stainless"

Cable entry/cable gland	Type of protection	Material
Cable gland M20 x 1.5	<ul style="list-style-type: none"> <li>■ Non-Ex</li> <li>■ Ex ia</li> <li>■ Ex ic</li> <li>■ Ex nA</li> <li>■ Ex tb</li> </ul>	Stainless steel 1.4404
Adapter for cable entry with internal thread G 1/2"	For non-Ex and Ex (except for CSA Ex d/XP)	Stainless steel 1.4404 (316L)
Adapter for cable entry with internal thread NPT 1/2"	For non-Ex and Ex	

Order code for "Housing": option C "Compact, aluminum coated", option J "Remote, aluminum coated"

Cable entry/cable gland	Type of protection	Material
Cable gland M20 x 1.5	<ul style="list-style-type: none"> <li>■ Non-Ex</li> <li>■ Ex ia</li> <li>■ Ex ic</li> </ul>	Plastic
	Adapter for cable entry with internal thread G 1/2"	Nickel-plated brass
Adapter for cable entry with internal thread NPT 1/2"	For non-Ex and Ex (except for CSA Ex d/XP)	Nickel-plated brass
Thread NPT 1/2" via adapter	For non-Ex and Ex	

### Connecting cable for remote version

- Standard cable: PVC cable with copper shield
- Reinforced cable: PVC cable with copper shield and additional steel wire braided jacket

### Sensor housing

- Coated aluminum AlSi10Mg
- Stainless cast steel, 1.4408 (CF3M), in compliance with NACE MR0175-2003 and MR0103-2003

### Measuring tubes

#### Pressure ratings up to PN 40, Class 150/300, and JIS 10K/20K:

Stainless cast steel, 1.4408 (CF3M), in compliance with AD2000 (for AD2000 the temperature range is limited to -10 to +400 °C (+14 to +752 °F) ) and in compliance with NACE MR0175-2003 and MR0103-2003

### DSC sensor

#### Pressure ratings up to PN 40, Class 150/300, and JIS 10K/20K:

Parts in contact with medium (marked as "wet" on the DSC sensor flange):

Stainless steel, 1.4435 (316, 316L), in compliance with NACE MR0175-2003 and MR0103-2003

Parts not in contact with medium:

- Stainless steel 1.4301 (304)
- Order code for "Sensor option", option CD "Harsh environment, DSC sensor, sensor components Alloy C22":

Alloy C22 sensor: UNS N06022 similar to Alloy C22/2.4602, in compliance with NACE MR0175-2003 and MR0103-2003

### Seals

- Graphite (standard)  
Pressure rating PN 10 to 40, Class 150 to 300, JIS 10 to 20K: Sigraflex Foil Z (BAM-certified for oxygen applications)
- FPM (Viton)
- Kalrez 6375
- Gylon 3504 (BAM-certified for oxygen applications, "high quality in terms of TA Luft (German Clean Air Act"))

### Housing support

Stainless steel, 1.4408 (CF3M)

### Accessories

*Weather protection cover*

Stainless steel 1.4301

*Flow conditioner*

Stainless steel, multiple certifications, 1.4404 (316, 316L), in compliance with NACE MR0175-2003 and MR0103-2003

## Operability

---

### Operating concept

#### Operator-oriented menu structure for user-specific tasks

- Commissioning
- Operation
- Diagnostics
- Expert level

#### Quick and safe commissioning

- Guided menus ("Make-it-run" wizards) for applications
- Menu guidance with brief explanations of the individual parameter functions



**Reliable operation**

- Operation in the following languages:
  - Via local display: English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Swedish, Turkish, Chinese, Japanese, Korean, Bahasa (Indonesian), Vietnamese, Czech
  - Via "FieldCare" operating tool: English, German, French, Spanish, Italian, Chinese, Japanese
- Uniform operating philosophy applied to device and operating tools
- If replacing the electronic module, transfer the device configuration via the integrated memory (integrated HistoROM) which contains the process and measuring device data and the event logbook. No need to reconfigure.

**Efficient diagnostics increase measurement availability**

- Troubleshooting measures can be called up via the device and in the operating tools
- Diverse simulation options, logbook for events that occur and optional line recorder functions



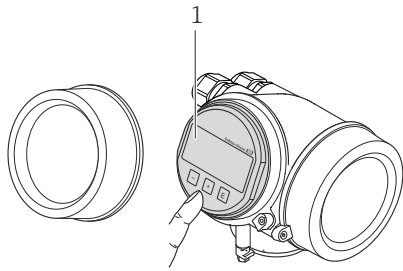



**Local operation****Via display module**

Order code for "Display; Operation", option <b>C</b> "SD02"	Order code for "Display; Operation", option <b>E</b> "SD03"
 <p style="text-align: right; font-size: small;">A0015544</p>	 <p style="text-align: right; font-size: small;">A0015546</p>
1 <i>Operation with pushbuttons</i>	1 <i>Operation with touch control</i>

**Display elements**

- 4-line display
- With order code for "Display; operation", option **E**: White background lighting; switches to red in event of device errors
- Format for displaying measured variables and status variables can be individually configured
- Permitted ambient temperature for the display:  $-20$  to  $+60$  °C ( $-4$  to  $+140$  °F)  
The readability of the display may be impaired at temperatures outside the temperature range.


**Operating elements**

- With order code for "Display; operation", option **C**: Local operation with 3 push buttons: , , 
- With order code for "Display; operation", option **E**: External operation via touch control; 3 optical keys: , , 
- Operating elements also accessible in various hazardous areas

**Additional functionality**

- Data backup function  
The device configuration can be saved in the display module.
- Data comparison function  
The device configuration saved in the display module can be compared to the current device configuration.
- Data transfer function  
The transmitter configuration can be transmitted to another device using the display module.

Via remote display and operating module FHX50

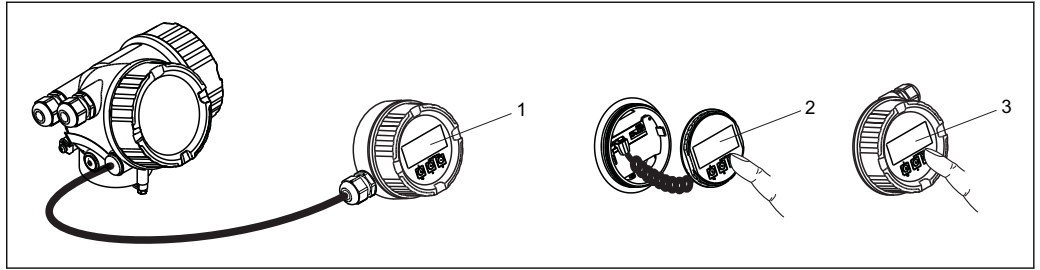


A0013137

22 Operating options via FHX50

- 1 Housing of remote display and operating module FHX50
- 2 SD02 display and operating module, push buttons; cover must be opened for operation
- 3 SD03 display and operating module, optical buttons: operation possible through cover glass

Remote operation

Via HART protocol

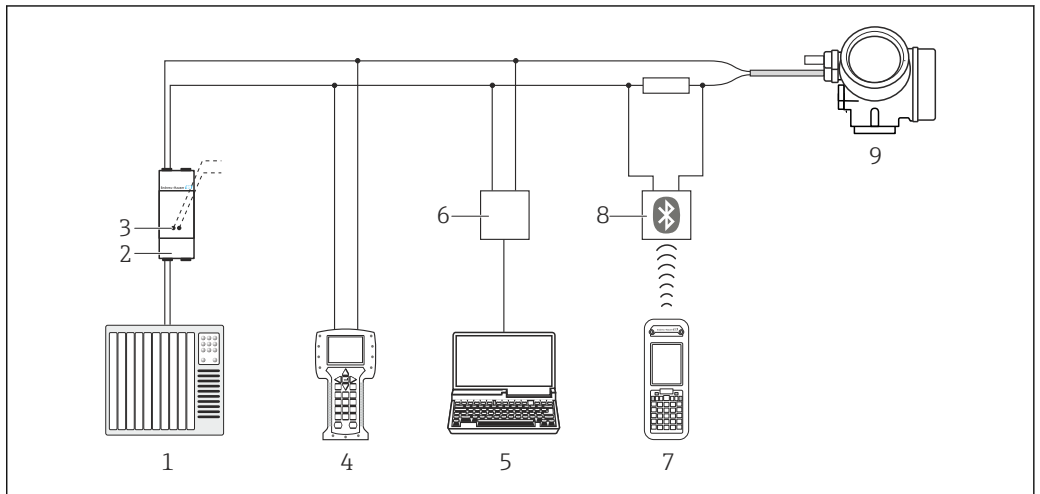


A0013764

23 Options for remote operation via HART protocol

- 1 Control system (e.g. PLC)
- 2 Transmitter power supply unit, e.g. RN221N (with communication resistor)
- 3 Connection for Commubox FXA195 and Field Communicator 475
- 4 Field Communicator 475
- 5 Computer with operating tool (e.g. FieldCare, AMS Device Manager, SIMATIC PDM)
- 6 Commubox FXA195 (USB)
- 7 Field Xpert SFX350 or SFX370
- 8 VIATOR Bluetooth modem with connecting cable
- 9 Transmitter

**Via service interface (CDI)**

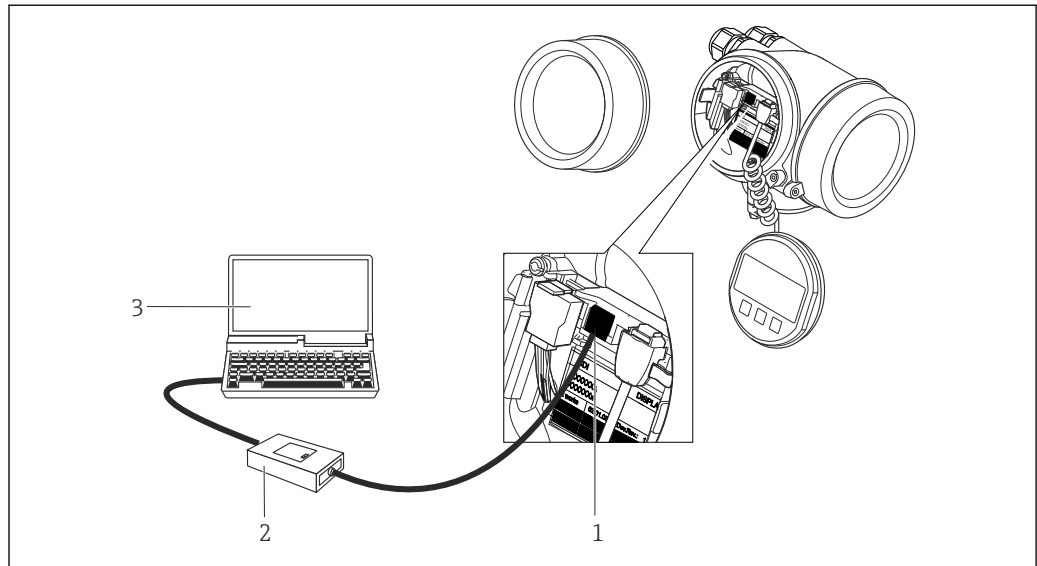


A0020545

- 1 Service interface (CDI = Endress+Hauser Common Data Interface) of the measuring device
- 2 Commubox FXA291
- 3 Computer with "FieldCare" operating tool with COM DTM "CDI Communication FXA291"

**Via PROFIBUS PA network**

This communication interface is present in the following device version:  
Order code for "Output", option **G**: PROFIBUS PA

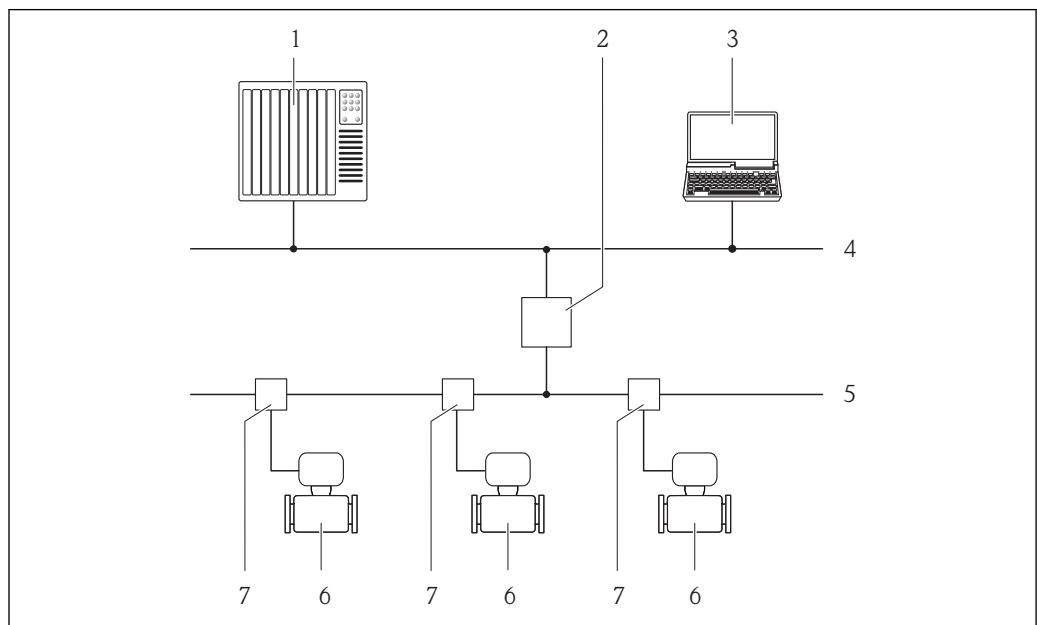

A0019013

- 1 Automation system
- 2 Segment coupler PROFIBUS DP/PA
- 3 Computer with PROFIBUS network card
- 4 PROFIBUS DP network
- 5 PROFIBUS PA network
- 6 Measuring device
- 7 T-box

## Certificates and approvals

### CE mark

The measuring system is in conformity with the statutory requirements of the applicable EC Directives. These are listed in the corresponding EC Declaration of Conformity along with the standards applied.

Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.

### C-Tick symbol

The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".

### Ex approval

The measuring device is certified for use in hazardous areas and the relevant safety instructions are provided in the separate "Safety Instructions" (XA) document. Reference is made to this document on the nameplate.



The separate Ex documentation (XA) containing all the relevant explosion protection data is available from your Endress+Hauser sales center.

#### ATEX, IECEx

Currently, the following versions for use in hazardous areas are available:

##### Ex d

Category	Type of protection
II2G/Zone 1	Ex d ia  IIC T6...T1
II1/2G/Zone 0/1	Ex d ia  IIC T6...T1

##### Ex ia

Category	Type of protection
II2G/Zone 1	Ex ia IIC T6...T1
II1G/Zone 0	Ex ia IIC T6...T1
II1/2G/Zone 0/1	Ex ia IIC T6...T1

##### Ex ic

Category	Type of protection
II3G/Zone 2	Ex ic IIC T6...T1
II1/3G/Zone 0/2	Ex ic ia  IIC T6...T1

##### Ex nA

Category	Type of protection
II3G/Zone 2	Ex nA IIC T6...T1

##### Ex tb

Category	Type of protection
II2D/Zone 2 1	Ex tb IIIC Txxx

**cCSAus**

Currently, the following versions for use in hazardous areas are available:

*XP*

Category	Type of protection
Class I, II, III Division 1 Groups A-G	XP (Ex d Flameproof version)

*IS*

Category	Type of protection
Class I, II, III Division 1 Groups A-G	IS (Ex i Intrinsically safe version)

*NI*

Category	Type of protection
Class I Division 2 Groups ABCD	NI (Non-incentive version), NIFW-Parameter*

\*= Entity- und NIFW-Parameter gemäß Control Drawings

**NEPSI**

Currently, the following versions for use in hazardous areas are available:

*Ex d*

Category	Type of protection
Zone 1	Ex d ia  IIC T1 ~ T6 Ex d ia Ga  IIC T1 ~ T6
Zone 0/1	Ex d ia  IIC T1 ~ T6 DIP A2.1 Ex d ia Ga  IIC T1 ~ T6 DIP A2.1

*Ex ia*

Category	Type of protection
Zone 1	Ex ia IIC T1 ~ T6
Zone 0/1	Ex ia IIC T1 ~ T6 DIP A2.1

*Ex ic*

Category	Type of protection
II3G/Zone 2	Ex ic IIC T1 ~ T6
II1/3G/Zone 0/2	Ex ic ia Ga  IIC T1 ~ T6

*Ex nA*

Category	Type of protection
Zone 2	Ex nA IIC T1 ~ T6 Ex nA ia Ga  IIC T1 ~ T6



**INMETRO**

Currently, the following versions for use in hazardous areas are available:

*Ex d*

Category	Type of protection
-	Ex d[ia] IIC T6...T1

*Ex ia*

Category	Type of protection
-	Ex ia IIC T6...T1

*Ex nA*



Category	Type of protection
-	Ex nA IIC T6...T1 Ex nA[ia Ga] IIC T6...T1

**Functional safety**

The measuring device can be used for flow monitoring systems (min., max., range) up to SIL 2 (single-channel architecture) and SIL 3 (multichannel architecture with homogeneous redundancy) and is independently evaluated and certified by the TÜV in accordance with IEC 61508.

The following types of monitoring in safety equipment are possible:

Volume flow

 Functional Safety Manual with information on the SIL device (→  79)

**Certification PROFIBUS**

**PROFIBUS interface**

The measuring device is certified and registered by the PROFIBUS User Organization (PNO). The measuring system meets all the requirements of the following specifications:

- Certified in accordance with PROFIBUS PA Profile 3.02
- The device can also be operated with certified devices of other manufacturers (interoperability)

**Pressure Equipment Directive**

- With the PED/G1/x (x = category) marking on the sensor nameplate, Endress+Hauser confirms compliance with the "Essential Safety Requirements" specified in Annex I of the Pressure Equipment Directive 97/23/EC.
- Devices bearing this marking (PED) are suitable for the following types of medium: Media in Group 1 and 2 with a vapor pressure greater than, or smaller and equal to 0.5 bar (7.3 psi)
- Devices not bearing this marking (PED) are designed and manufactured according to good engineering practice. They meet the requirements of Art.3 Section 3 of the Pressure Equipment Directive 97/23/EC. The range of application is indicated in tables 6 to 9 in Annex II of the Pressure Equipment Directive.

**Other standards and guidelines**

- EN 60529  
Degrees of protection by housing (IP code)
- DIN ISO 13359  
Measurement of conductive liquid flow in closed conduits - Flanged-type electromagnetic flowmeters - Overall length
- EN 61010-1  
Protection Measures for Electrical Equipment for Measurement, Control, Regulation and Laboratory Procedures.
- IEC/EN 61326  
Emission in accordance with Class A requirements. Electromagnetic compatibility (EMC requirements)
- NAMUR NE 21  
Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment.
- NAMUR NE 32  
Data Retention in the Event of a Power Failure in Field and Control Instruments with Microprocessors

- NAMUR NE 43  
Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 53  
Software of field devices and signal-processing devices with digital electronics
- NAMUR NE 105  
Specifications for Integrating Fieldbus Devices in Engineering Tools for Field Devices
- NAMUR NE 107  
Self-monitoring and diagnosis of field devices
- NAMUR NE 131  
Requirements for field devices for standard applications
- ASME BPVC Section VIII, Division 1  
Rules for Construction of Pressure Vessels

## Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: [www.endress.com](http://www.endress.com) → Select country → Instruments → Select device → Product page function: Configure this product
- From your Endress+Hauser Sales Center: [www.endress.com/worldwide](http://www.endress.com/worldwide)



### Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
  - Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
  - Automatic verification of exclusion criteria
  - Automatic creation of the order code and its breakdown in PDF or Excel output format
  - Ability to order directly in the Endress+Hauser Online Shop

## Application packages

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered from Endress+Hauser either directly with the device or subsequently. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: [www.endress.com](http://www.endress.com).



For detailed information on the application packages, see the Special Documentation for the device (→ 79)

### Diagnostics functions

Package	Description
HistoROM extended function	<p>Comprises extended functions concerning the event log and the activation of the measured value memory.</p> <p>Event log: Memory volume is extended from 20 message entries (basic version) to up to 100 entries.</p> <p>Data logging (line recorder):</p> <ul style="list-style-type: none"> <li>■ Memory capacity for up to 1000 measured values is activated.</li> <li>■ 250 measured values can be output via each of the 4 memory channels. The recording interval can be defined and configured by the user.</li> <li>■ Data logging is visualized via the local display or FieldCare.</li> </ul>

Heartbeat Technology	
Package	Description
Heartbeat Verification	<p><b>Heartbeat Verification:</b>                      Makes it possible to check the device functionality on demand when the device is installed, without having to interrupt the process.</p> <ul style="list-style-type: none"> <li>▪ Access via onsite operation or other operating interfaces, such as FieldCare for instance.</li> <li>▪ Documentation of device functionality within the framework of manufacturer specifications, for proof testing for instance.</li> <li>▪ End-to-end, traceable documentation of the verification results, including report.</li> <li>▪ Makes it possible to extend calibration intervals in accordance with operator's risk assessment.</li> </ul>

Air and industrial gases	
Package	Description
Air and industrial gases	<p>This application package enables users to calculate the density and energy of air and industrial gases. The calculations are based on time-tested standard calculation methods. It is possible to automatically compensate for the effect of pressure and temperature via an external or constant value.</p> <p>With this application package it is possible to output the energy flow, standard volume flow and mass flow of the following fluids:</p> <ul style="list-style-type: none"> <li>▪ Air</li> <li>▪ Single gas</li> <li>▪ Gas mixture</li> <li>▪ User-specific gas</li> </ul>






Natural gas	
Package	Description
Natural gas	<p>This application package enables users to calculate the chemical properties (gross calorific value, net calorific value) of natural gases. The calculations are based on time-tested standard calculation methods. It is possible to automatically compensate for the effect of pressure and temperature via an external or constant value.</p> <p>With this application package it is possible to output the energy flow, standard volume flow and mass flow based on the following standard methods:</p> <p>Energy can be calculated based on the following standards:</p> <ul style="list-style-type: none"> <li>▪ AGA5</li> <li>▪ ISO 6976</li> <li>▪ GPA 2172</li> </ul> <p>Density can be calculated based on the following standards:</p> <ul style="list-style-type: none"> <li>▪ ISO 12213-2 (AGA8-DC92)</li> <li>▪ ISO 12213-3</li> <li>▪ AGA NX19</li> <li>▪ AGA8 Gross 1</li> <li>▪ SGERG 88</li> </ul>

## Accessories


Various accessories, which can be ordered with the device or subsequently from Endress+Hauser, are available for the device. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: [www.endress.com](http://www.endress.com).

## Device-specific accessories









## For the transmitter

Accessories	Description
Prowirl 200 transmitter	<p>Transmitter for replacement or for stock. Use the order code to define the following specifications:</p> <ul style="list-style-type: none"> <li>■ Approvals</li> <li>■ Output</li> <li>■ Display / operation</li> <li>■ Housing</li> <li>■ Software</li> </ul> <p> For details, see Installation Instructions EA01056D</p>
Remote display FHX50	<p>FHX50 housing to accommodate a display module (→  69).</p> <ul style="list-style-type: none"> <li>■ FHX50 housing suitable for: <ul style="list-style-type: none"> <li>– SD02 display module (push buttons)</li> <li>– SD03 display module (touch control)</li> </ul> </li> <li>■ Housing material: <ul style="list-style-type: none"> <li>– Plastic PBT</li> <li>– 316L</li> </ul> </li> <li>■ Length of connecting cable: up to max. 60 m (196 ft) (cable lengths available for order: 5 m (16 ft), 10 m (32 ft), 20 m (65 ft), 30 m (98 ft))</li> </ul> <p>The measuring device can be ordered with the FHX50 housing and a display module. The following options must be selected in the separate order codes:</p> <ul style="list-style-type: none"> <li>■ Order code for measuring device, feature 030: Option L or M "Prepared for FHX50 display"</li> <li>■ Order code for FHX50 housing, feature 050 (device version): Option A "Prepared for FHX50 display"</li> <li>■ Order code for FHX50 housing, depends on the desired display module in feature 020 (display, operation): <ul style="list-style-type: none"> <li>– Option C: for an SD02 display module (push buttons)</li> <li>– Option E: for an SD03 display module (touch control)</li> </ul> </li> </ul> <p>The FHX50 housing can also be ordered as a retrofit kit. The measuring device display module is used in the FHX50 housing. The following options must be selected in the order code for the FHX50 housing:</p> <ul style="list-style-type: none"> <li>■ Feature 050 (measuring device version): option B "Not prepared for FHX50 display"</li> <li>■ Feature 020 (display, operation): option A "None, existing displayed used"</li> </ul> <p> For details, see Special Documentation SD01007F</p>
Overvoltage protection for 2-wire devices	<p>Ideally, the overvoltage protection module should be ordered directly with the device. See product structure, characteristic 610 "Accessory mounted", option NA "Overvoltage protection". Separate order necessary only if retrofitting.</p> <ul style="list-style-type: none"> <li>■ OVP10: For 1-channel devices (characteristic 020, option A):</li> <li>■ OVP20: For 2-channel devices (characteristic 020, options B, C, E or G)</li> </ul> <p> For details, see Special Documentation SD01090F.</p>
Weather protection cover	<p>Is used to protect the measuring device from the effects of the weather: e.g. rainwater, excess heating from direct sunlight or extreme cold in winter.</p> <p> For details, see Special Documentation SD00333F</p>
Connecting cable for remote version	<ul style="list-style-type: none"> <li>■ Connecting cable available in various lengths: <ul style="list-style-type: none"> <li>– 5 m (16 ft)</li> <li>– 10 m (32 ft)</li> <li>– 20 m (65 ft)</li> <li>– 30 m (98 ft)</li> </ul> </li> <li>■ Reinforced cables available on request.</li> </ul>
Post mounting kit	Post mounting kit for transmitter.


## For the sensor

Accessories	Description
Mounting kit	<p>Mounting set for disc (wafer version) comprising:</p> <ul style="list-style-type: none"> <li>■ Tie rods</li> <li>■ Seals</li> <li>■ Nuts</li> <li>■ Washers</li> </ul> <p> For details, see Installation Instructions EA00075D</p>
Flow conditioner	Is used to shorten the necessary inlet run.






## Communication-specific accessories

Accessories	Description
Commubox FXA195 HART	<p>For intrinsically safe HART communication with FieldCare via the USB interface.</p> <p> For details, see "Technical Information" TI00404F</p>
Commubox FXA291	<p>Connects Endress+Hauser field devices with a CDI interface (= Endress+Hauser Common Data Interface) and the USB port of a computer or laptop.</p> <p> For details, see "Technical Information" TI00405C</p>
HART Loop Converter HMX50	<p>Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.</p> <p> For details, see "Technical Information" TI00429F and Operating Instructions BA00371F</p>
Wireless HART adapter SWA70	<p>Is used for the wireless connection of field devices. The WirelessHART adapter can be easily integrated into field devices and existing infrastructures, offers data protection and transmission safety and can be operated in parallel with other wireless networks with minimum cabling complexity.</p> <p> For details, see Operating Instructions BA00061S</p>
Fieldgate FXA320	<p>Gateway for the remote monitoring of connected 4-20 mA measuring devices via a Web browser.</p> <p> For details, see "Technical Information" TI00025S and Operating Instructions BA00053S</p>
Fieldgate FXA520	<p>Gateway for the remote diagnostics and remote configuration of connected HART measuring devices via a Web browser.</p> <p> For details, see "Technical Information" TI00025S and Operating Instructions BA00051S</p>
Field Xpert SFX350	<p>Field Xpert SFX350 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the <b>non-Ex area</b>.</p> <p> For details, see Operating Instructions BA01202S</p>
Field Xpert SFX370	<p>Field Xpert SFX370 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the <b>non-Ex area</b> and the <b>Ex area</b>.</p> <p> For details, see Operating Instructions BA01202S</p>

## Service-specific accessories

Accessories	Description
Applicator	<p>Software for selecting and sizing Endress+Hauser measuring devices:</p> <ul style="list-style-type: none"> <li>■ Calculation of all the necessary data for identifying the optimum flowmeter: e.g. nominal diameter, pressure loss, accuracy or process connections.</li> <li>■ Graphic illustration of the calculation results</li> </ul> <p>Administration, documentation and access to all project-related data and parameters over the entire life cycle of a project.</p> <p>Applicator is available:</p> <ul style="list-style-type: none"> <li>■ Via the Internet: <a href="https://wapps.endress.com/applicator">https://wapps.endress.com/applicator</a></li> <li>■ On CD-ROM for local PC installation.</li> </ul>
W@M	<p>Life cycle management for your plant</p> <p>W@M supports you with a wide range of software applications over the entire process: from planning and procurement, to the installation, commissioning and operation of the measuring devices. All the relevant device information, such as the device status, spare parts and device-specific documentation, is available for every device over the entire life cycle.</p> <p>The application already contains the data of your Endress+Hauser device. Endress+Hauser also takes care of maintaining and updating the data records.</p> <p>W@M is available:</p> <ul style="list-style-type: none"> <li>■ Via the Internet: <a href="http://www.endress.com/lifecyclemanagement">www.endress.com/lifecyclemanagement</a></li> <li>■ On CD-ROM for local PC installation.</li> </ul>
FieldCare	<p>FDT-based plant asset management tool from Endress+Hauser.</p> <p>It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition.</p> <p> For details, see Operating Instructions BA00027S and BA00059S</p>

## System components

Accessories	Description
Memograph M graphic display recorder	<p>The Memograph M graphic display recorder provides information on all relevant measured variables. Measured values are recorded correctly, limit values are monitored and measuring points analyzed. The data are stored in the 256 MB internal memory and also on a SD card or USB stick.</p> <p> For details, see "Technical Information" TI00133R and Operating Instructions BA00247R</p>
RN221N	<p>Active barrier with power supply for safe separation of 4-20 mA standard signal circuits. Offers bidirectional HART transmission.</p> <p> For details, see "Technical Information" TI00073R and Operating Instructions BA00202R</p>
RNS221	<p>Supply unit for powering two 2-wire measuring devices solely in the non-Ex area. Bidirectional communication is possible via the HART communication jacks.</p> <p> For details, see "Technical Information" TI00081R and Brief Operating Instructions KA00110R</p>
Cerabar M	<p>The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.</p> <p> For details, see "Technical Information" TI00426P, TI00436P and Operating Instructions BA00200P, BA00382P</p>
Cerabar S	<p>The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.</p> <p> For details, see "Technical Information" TI00383P and Operating Instructions BA00271P</p>

## Documentation



For an overview of the scope of the associated Technical Documentation, refer to the following:

- The CD-ROM provided for the device (depending on the device version, the CD-ROM might not be part of the delivery!)
- The *W@M Device Viewer* : Enter the serial number from the nameplate ([www.endress.com/deviceviewer](http://www.endress.com/deviceviewer))
- The *Endress+Hauser Operations App*: Enter the serial number from the nameplate or scan the 2-D matrix code (QR code) on the nameplate.

### Standard documentation

#### Brief Operating Instructions

Measuring device	Documentation code
Prowirl D 200	KA01135D

#### Operating Instructions

Measuring device	Documentation code		
	HART	FOUNDATION Fieldbus	PROFIBUS PA
Prowirl D 200	BA01153D	BA01216D	BA01221D

### Supplementary device-dependent documentation

#### Safety Instructions

Contents	Documentation code
ATEX/IECEX Ex d, Ex tb	XA01148D
ATEX/IECEX Ex ia, Ex tb	XA01151D
ATEX/IECEX Ex ic, Ex nA	XA01152D
cCSA <sub>US</sub> XP	XA01153D
cCSA <sub>US</sub> IS	XA01154D
NEPSI Ex d	XA01238D
NEPSI Ex i	XA01239D
NEPSI Ex ic, Ex nA	XA01240D
INMETRO Ex d	XA01250D
INMETRO Ex i	XA01042D
INMETRO Ex nA	XA01043D

#### Special Documentation

Contents	Documentation code
Information on the Pressure Equipment Directive	SD01163D
Functional Safety Manual	SD01162D
Heartbeat Technology	SD01204D
Natural gas	SD01194D
Air + Industrial Gases (Single Gas + Gas Mixtures)	SD01195D

#### Installation Instructions

Contents	Documentation code
Installation Instructions for spare part sets	Specified for each individual accessory (→ 76)

## Registered trademarks

**HART®**

Registered trademark of the HART Communication Foundation, Austin, USA

**PROFIBUS®**

Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

**KALREZ® , VITON®**

Registered trademarks of DuPont Performance Elastomers L.L.C., Wilmington, DE USA

**GYLON®**

Registered trademark of Garlock Sealing Technologies, Palmyra, NY, USA

**Applicator® , FieldCare® , Field Xpert™ , HistoROM® , Heartbeat Technology™**

Registered or registration-pending trademarks of the Endress+Hauser Group

[www.addresses.endress.com](http://www.addresses.endress.com)

---